


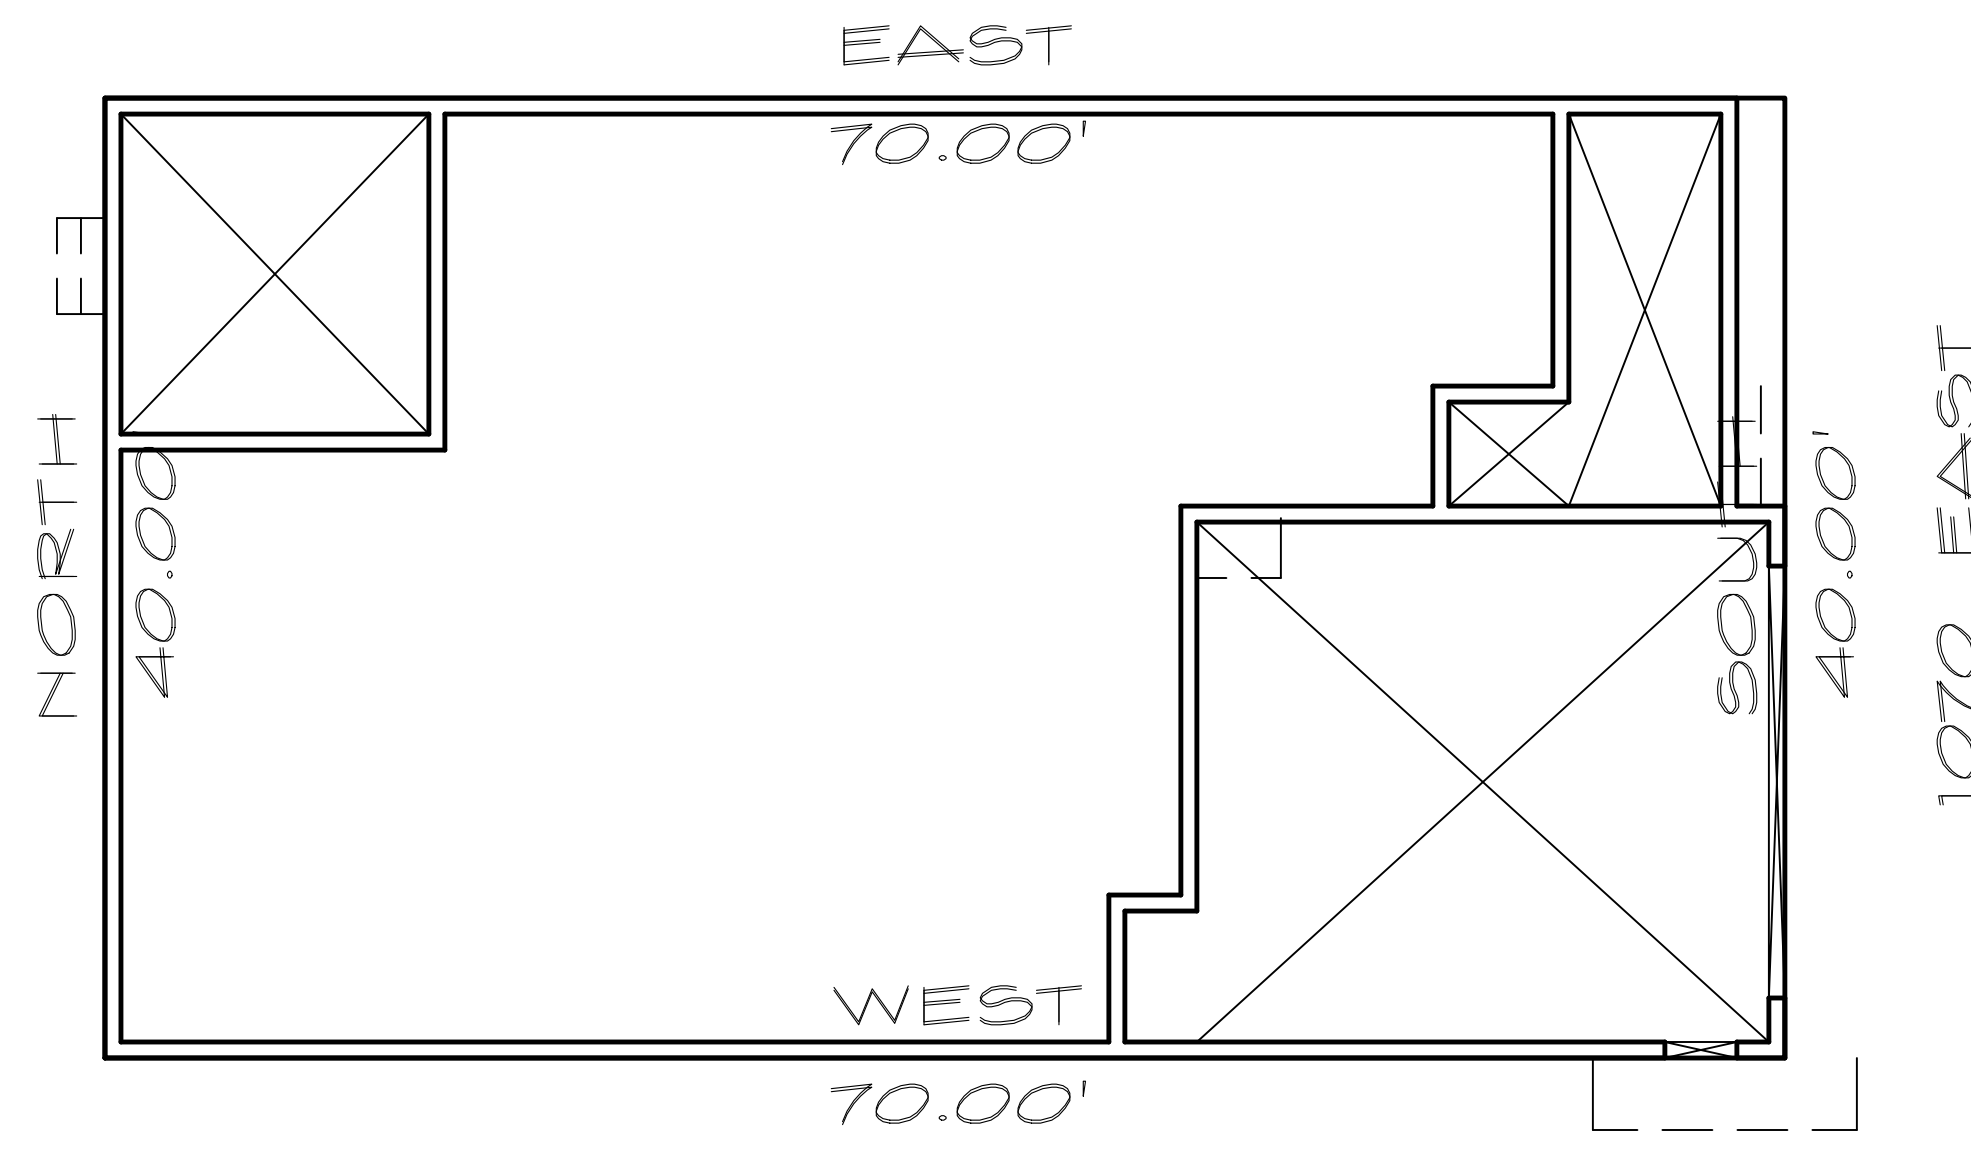

 Design Concepts Inc. D & D		8385 SOUTH 3200 WEST Spanish Fork, UT 84660 801-794-3738 Web: www.dddesignconcepts.com		PHILLIPS CONSTRUCTION SITE PLAN PAYSON, UTAH		REVISIONS	
DRAWN BY: JM		DATE: 08/25		SCALE: 1/8" = 1'-0"		PROJECT # 2K2525	
SHEET #		SITE					

GENERAL CONSTRUCTION NOTES:

GENERAL INFO:

WHEN CALLING FOR AN INSPECTION, CONTRACTOR MUST PROVIDE PERMIT NUMBER, ADDRESS, TYPE OF INSPECTION, AND DATE INSPECTION IS NEEDED. INSPECTIONS NEED TO BE CALLED IN MIN. OF 24 - 48 HOURS BEFORE INSPECTION IS NEEDED.

WORK IS NOT TO BEGIN BEFORE PERMIT IS ISSUED, AND PLANS MUST BE FOLLOWED AS APPROVED EVEN IF THEY EXCEED CODE. THE APPROVED SET OF PLANS AND INSPECTION CARD NEED TO BE ON BUILDING SITE FOR ALL INSPECTIONS.

THE FOLLOWING INSPECTIONS ARE REQUIRED. PLEASE MAKE SURE THAT ALL ITEMS LISTED BELOW ARE COMPLETE AND READY FOR INSPECTION. NOTE THIS MAY VARY FROM CITY TO CITY.

FOOTINGS:

- BE SURE THAT ALL SETBACKS ARE CORRECT.
- SETBACKS ARE MEASURED FROM THE PROPERTY LINE, NOT THE SIDEWALK.
- LOT CORNERS ARE TO BE STAKED OR OTHERWISE EASY TO LOCATE.
- FOOTINGS ARE TO BE CONTINUOUS.
- HORIZONTAL STEEL IS TO BE TIED IN PLACE.
- INTERIOR WALL FOOTINGS ARE NOT INSPECTED AT THE TIME OF OUTSIDE FOOTINGS, BUT MUST BE INSPECTED BEFORE FLOOR IS POURED.
- THE STEEL IS TO BE CLEAN AND FREE OF GREASE & MUD.
- VERTICAL STEEL MUST BE BENT AND ON THE SITE FOR INSPECTION.

UNDERGROUND PLUMBING:

- ALL PIPES INCLUDING WATER AND WASTE AS APPLICABLE ARE TO BE INSTALLED AND SHUTTERED AT LEAST 21 PAST THE FOUNDATION.
- PRESSURE TEST ARE TO BE PROVIDED AS REQUIRED.
- PIPING IS NOT TO BE COVERED EXCEPT THE MINIMUM NEEDED TO HOLD THE PIPES IN PLACE WITH NO JOINTS COVERED.

UNDERGROUND MECHANICAL:

- IN PLACE AND NOT COVERED AND ALL JOINTS TO BE IN PLACE.

TEMPORARY POWER:

- THE TEMPORARY POWER IS TO BE IN PLACE WITH THE UNDERGROUND OR OVERHEAD PIPING IN PLACE.
- THE SERVICE BASE IS TO BE SECURELY INSTALLED AND PROTECTED FROM DAMAGE AND A GROUND ROD MUST BE INSTALLED.
- BEFORE POWER WILL BE CONNECTED, THE OWNER/CONTRACTOR MUST SIGN UP FOR UTILITIES AT THE CITY OFFICES.

BUILDING WATER:

- ALL PIPES ARE TO BE INSTALLED AT REQUIRED DEPTHS.
- BEFORE WATER METER IS INSTALLED OWNER/CONTRACTOR MUST SIGN UP FOR UTILITIES AT THE CITY OFFICES.

BUILDING SEWER:

- ALL PIPES ARE TO BE INSTALLED AT PROPER SLOPES.

ROUGH FOUR WAY:

- FRAMING CANNOT BE APPROVED UNTIL THE ELECTRICAL, PLUMBING, AND MECHANICAL ROUGHS ARE FINISHED.

ELECTRICAL:

- ALL WIRING INSTALLED.
- RECESS CANS INSTALLED.
- ALL WIRES IN BOX NEED TO BE MADE UP AND GROUNDS MECHANICALLY CONNECTED.
- ALL BONDING INSTALLED & CONNECTED.
- ALL VENT FANS AND DUCTS INSTALLED.

PLUMBING:

- ALL WASTE, WATER, AND GAS PIPING INSTALLED WITH APPROPRIATE PRESSURE TEST PROVIDED.
- ALL SHOWER PANS INSTALLED AND FILLED WITH WATER.

MECHANICAL:

- THE FURNACE AND ALL DUCTS NEED TO BE INSTALLED, COMBUSTION AIR DUCTS NEED TO BE INSTALLED AND PROPERLY SIZED.
- ANY COOLING DUCTS OR PIPING SIZED.
- IF HOT WATER HEAT IS USED THE PIPES NEED TO BE INSTALLED AND UNDER APPROPRIATE PRESSURE.
- PREFABRICATED FIREPLACES INSTALLED INCLUDING THE FLUES, COMBUSTION AIR, AND FIRE BLOCKING.

FRAMING:

- FRAMING IS TO BE APPROVED PRIOR TO THE SIDING OR BRICK BEING INSTALLED.
- ALL FRAMING MEMBERS ARE TO BE INSTALLED.
- INTERIOR STAIRS INSTALLED.
- ALL BLOCKING AND BRACING INSTALLED.
- ALL WINDOWS ARE TO BE INSTALLED.

DRYWALL:

- ALL DRYWALL TO BE NAILED OR SCREWED IN PLACE
- USE #8 TYPE X DRYWALL IN GARAGE
- A FIRE WALL FROM SLAB TO TRUSS, REQ. BETWEEN GARAGE, & STRUCTURE, USING #8 TYPE X
- A DOUBLE LAYER OF #8 TYPE X REQ. FOR CEILINGS IN GARAGES
- #8 TYPE X SHEETROCK REQUIRED ON WALLS & SOFFITS UNDER AN ENCLOSED STAIRWAY.

GAS METER:

- THE GAS LINE MUST BE INSTALLED AND THE REQUIRED PRESSURE TEST PROVIDED.
- AT LEAST ONE GAS APPLIANCE MUST BE INSTALLED AND READY TO BE TURNED ON.
- COMBUSTION AIR INSTALLED.

PERMANENT POWER:

- PERMANENT POWER WILL NOT BE APPROVED UNTIL AFTER THE BUILDING PERMIT IS FINALIZED.
- ALL WIRING, COVERS, LIGHTS, RECEPTACLES, SWITCHES, AND BONDING SHALL BE IN PLACE.
- BREAKER BOX AND MAIN DISCONNECT LABELED.

FINAL INSPECTION:

- THE BUILDING NEEDS TO BE FINISHED INCLUDING FLOOR COVERINGS, READY FOR PERMANENT POWER, PLUMBING, AND MECHANICAL SYSTEMS FINISHED.
- ALL STEPS, GUARDRAILS AND HANDRAILS INSTALLED.
- EXTERIOR GRADING AND CONCRETE WORK FINISHED.
- CITY SIDE WALK AND CURB (IF REQUIRED) INSTALLED TO CITY SPECIFICATIONS.
- A LADDER NEEDS TO BE PROVIDED SO THAT THE ATTIC AREA AND ROOF CAN BE INSPECTED.

OCCUPANCY PERMITS SHALL NOT BE GRANTED UNTIL FINAL INSPECTION IS COMPLETED. INSPECTION REQUIREMENTS VARY FROM CITY TO CITY AND ARE SUBJECT TO THEIR REQUIREMENTS.

GENERAL CONCRETE:

- 9. NO ALUMINUM PRODUCTS SHALL BE EMBEDDED IN CONCRETE. ELECTRICAL CONDUITS SHALL PLACED IN MID-HEIGHT OF SLABS AND SHALL HAVE AN O.D. LESS THAN 1/3 SLAB THICKNESS.

ICE BARRIER:

- 19. ICE BARRIER SHALL BE INSTALLED @ ALL ROOF EDGES, & EYES, USING APPROVED MATERIALS, OR A DOUBLE LAYER OF TYPE 15 FELT APPLIED SHINGLE FASHION AND SOLID MOPED TOGETHER WITH APPROVED CEMENTING MATERIAL BETWEEN THE PILES EXTENDING FROM THE EAVE UP THE ROOF TO A POINT 24" INSIDE THE EXTERIOR WALL LINE OF THE BUILDING.

VAPOR BARRIER:

- 20. ALL WALLS IN HEATED AREAS SHALL HAVE A VAPOR BARRIER BETWEEN HEATED AREA, & INSULATION TO PREVENT CONDENSATION

- 21. ALL REQUIRED EGRESS WINDOWS, INCLUDING AT LEAST ONE IN EVERY BASEMENT AND BEDROOM SHALL HAVE A MINIMUM CLEAR OPEN ABLE AREA OF 57 SQ. FT., A MINIMUM HEIGHT OF 24" AND MINIMUM WIDTH OF 20" AND A FINISHED SILL HEIGHT OF NOT MORE THAN 44".
- 22. WINDOW WELLS SHALL PROVIDE NET CLEAR OPENING OF 9 SQUARE FEET WITH A MINIMUM DIMENSION OF 36". PROVIDE PERMANENT LADDER IF WINDOW WELL IS MORE THAN 44" DEEP.

- 24. DAMP PROOFING IS REQ'D FOR ALL FOUNDATIONS ENCLOSING BASEMENTS BELOW FINISH GRADE.
- 25. EXPOSED FOUNDATIONS SHALL BE PLASTERED FOR THE FINAL INSPECTION.

- 27. FIRE BLOCKING IS REQ'D IN WALLS AT ALL SOFFITS, DROPPED CEILINGS, COVE CEILINGS, AND AT THE FLOOR AND CEILING LEVELS OF ALL SHAFTS AND CHASES.
- 28. UNDER STAIR SPACE THAT IS ENCLOSED AND USABLE SHALL HAVE THE WALLS AND CEILINGS #8 TYPE X SHEETROCK.
- 29. MINIMUM 2 x 6 WALL BLOCKING IS REQUIRED FOR SHOWER PAN
- 30. RIM JOISTS SHALL BE PROTECTED WHERE CONCRETE WILL BE POURED AGAINST THEM
- 31. ATTIC VENTILATION LOCATED IN GABLE ENDS ONLY SHALL BE A TOTAL OF 1/50TH OF THE AREA OF THE SPACE VENTILATED.
- 32. ATTIC ACCESS OPENINGS ARE REQUIRED FOR ALL ATTICS 30" OR GREATER IN HEIGHT.
- 33. CRICKETS ARE REQUIRED WHERE CHIMNEYS OR OTHER VERTICAL SURFACES INTERSECT SLOPED ROOF AREAS. THEREBY CREATING WATER, SNOW, OR ICE DAMMING CONDITIONS.
- 34. STEP FLASHINGS OR FLASHINGS SHALL BE COUNTER FLASHED AT CHIMNEY OR WALL INTERSECTIONS WITH ROOFS.
- 35. GLASS IF INSTALLED IN OR WITHIN 24" OF DOORS, SHALL BE TEMPERED, UNLESS THE GLASS IN THE DOOR HAS ONE DIMENSION LESS THAN 3" OF THE BOTTOM EDGE OF THE GLASS ADJACENT TO THE DOOR IS 60" OR MORE FROM THE FLOOR.
- 36. FINISH GRADING SHALL SLOPE 2% AWAY FROM ALL BUILDINGS OR PROVIDE EQUIVALENT DRAINAGE PROTECTION. DRAINAGE FROM ROOFS OR LANDSCAPING SHALL NOT FLOW OVER OR ONTO ADJACENT PROPERTIES.
- 37. ADDRESS NUMBERS ARE REQUIRED FOR ALL BUILDINGS, AND SHALL BE AT LEAST 3" HIGH SO AS TO BE PLAINLY VISIBLE FROM THE STREET FRONTING THE PROPERTY.

ELECTRICAL:

- 38. METER PANELS SHALL BE AT LEAST 36" AWAY FROM ALL DOORS AND WINDOWS.
- 39. MAIN DISCONNECTS ARE REQUIRED ON EXTERIOR OF ALL BUILDINGS.
- 40. BREAKER PANELS SHALL NOT BE LOCATED ON THE EXTERIOR OF THE BUILDING.
- 41. BOND ELECTRICAL GROUNDING SYSTEM TO ALL METALIC WATER & GAS SERVICES AND ALL CONCRETE ENCASED ELECTRODES AVAILABLE FOR USE AS A GROUNDING ELECTRODE FOR THE HOUSE, WHICH MEET THE REQUIREMENTS OF THE 2008 NEC SEC. 250-50 (G)
- 42. INSTALL A MIN. OF 2 GFCI RECEPTACLES (ONE REAR, ONE FRONT)
- 43. ALL REQUIRED REC. SHALL BE PLACED SO THAT AT NO POINT ALONG THE FLOOR LINE OF WALLS, COUNTERS, ETC. SHALL THE DISTANCE TO A REC. BE GREATER THAN 6'.
- 44. FIRE RATED NON-METALIC BOXES SHALL BE USED IN WALL SEPARATING HOUSES ALONG GARAGE.
- 45. SMOKE DETECTORS SHALL BE INSTALLED IN EACH BEDROOM AND ADJACENT HALLWAYS AND ON EACH LEVEL. THEY SHALL BE WIRED IN SERIES AND HAVE BATTERY BACKUP.
- 46A. GFCI OUTLETS TO BE MOUNTED IN GARAGE 48" ABOVE PAD LEVEL.
- 46B. PROVIDE ARC FAULT PROTECTION ON ALL BEDROOM LIGHTS, SWITCHES, SMOKE DETECTORS AND RECEPTACLES.

MECHANICAL:

- 47. GAS METERS SHALL BE LOCATED PER QUESTAR GAS CO. AND SHALL BE A MIN. OF 3' FROM ELECTRICAL METER PANELS AND PERMANENT AIR VENTS.
- 48. ADEQUATE COMBUSTION AIR IS REQUIRED FOR ALL FUEL BURNING APPLIANCES.
- 49. VENTILATING FANS ARE REQUIRED FOR ALL BATHROOMS WITH TUBS OR SHOWERS AND FOR LAUNDRY ROOMS WHEN THESE ROOMS HAVE NO OPEN ABLE WINDOW TO THE EXTERIOR.
- 50. ALL BATHROOM AND LAUNDRY FANS SHALL BE VENTED THE THE EXTERIOR OF THE BUILDING.
- 51. DRYER VENT SHALL BE A MIN. OF 14" WITH TWO ELBOWS.
- 52. RANGE AND COOK TOP CLEARANCES TO UNPROTECTED COMBUSTIBLES SHALL BE 30" MIN.
- 53. ALL HEATING/AC SUPPLY DUCTS SHALL BE INSULATED UNFINISHED AREAS, AS PER CODE.

PLUMBING:

- 54. VENTING IS REQ'D FOR ALL FIXTURES TRAPS AS PER CODE.
- 55. NO PIPING SHALL BE INSTALLED SO AS TO BE SUBJECT TO FREEZING.
- 56. NO LEAD OR ACID BEARING SOLDER OR FLUES AR ALLOWED FOR POTABLE WATER PIPING SYSTEMS.
- 57. PRESSURE REDUCING VALVES ARE REQ'D WHEN WATER PRESSURE EXCEEDS 60 PSI.
- 58. BACK FLOW PROTECTION IS REQ'D FOR ALL HOSE BIBS, LAWN SPRINKLER SYSTEMS, AND ALL OTHER OUTLETS HAVING HOSE THREADS OR POSING POTENTIAL CROSS CONNECTIONS WITH CITY WATER SYSTEMS.
- 59. FLOOR DRAINS SHALL BE PROVIDED NEAR ALL WATER HEATERS AND SHALL HAVE CAST METAL BODIES AND GRATES.
- 60. FLOOR DRAINS SHALL BE FULLY VISIBLE AND ACCESSIBLE.
- 61. WATER CLOSET SPACES SHALL BE A MIN. OF 30" IN WIDTH AND ALLOW FOR A MINIMUM FRONT CLEARANCE OF 24".
- 62. SHOWER FLOOR SPACES SHALL BE A MIN. OF 100 SQ. IN. AND SHALL BE ABLE TO ENCOMPASS A 30" CIRCLE TO THE HEIGHT OF 72" AND SHALL BE FRAMED FOR A MIN. 22" DOOR.
- 63. AIR GAP PROTECTION IS REQ'D ON ALL DISHWASHER DRAIN CONNECTIONS TO THE DMV SYSTEM.
- 64. UNFINISHED PLUMBING DMV ROUGH - ING SHALL BE PROPERLY VENTED AND CAPPED OFF.
- 66. ALL OUTSIDE OR GARAGE FAUCETS SHALL BE FROST PROTECTED, & WILL DRAIN WHEN SHUT OFF.

GRADING & DRAINAGE:

- 67. TOP OF FOUNDATION WALL SHALL BE A MINIMUM, OF 24" ABOVE THE HIGHEST POINT AT TOP BACK OF SIDEWALK, OR TOP OF CURB IN FRONT OF LOT.
- 68. FINISH GRADING SHALL BE COMPLETED IN SUCH A WAY THAT ALL DRAINAGE FOR ANY GIVEN LOT SHALL FLOW TOWARD THE STREET, AND SHALL NOT FLOW OVER OR INTO ADJACENT PROPERTIES.
- 69. ALL BACKFILL AREAS TO MEET THE COMPACTION REQUIREMENTS OF THE 2006 IRC.
- 70. ALL DIRT RAMPS OVER SIDEWALKS ARE TO BE OF ROAD BASE MATERIAL.

GENERAL REQUIREMENTS:

1. PROVIDE A 22" x 34" ATTIC ACCESS IN LOCATION OF OWNERS CHOICE.
2. TELEPHONE AND TV JACK LOCATIONS SHALL BE DETERMINED BY OWNER AT THE TIME OF INSTALLATION.
3. SMOKE ALARMS SHALL BE INSTALLED IN EACH BEDROOM AND ADJACENT HALLWAYS. THEY SHALL BE WIRED IN SERIES AND BE PROVIDED WITH A BATTERY BACKUP.
4. ELECTRICAL PANEL LOCATIONS SHALL BE DETERMINED BY CONTRACTOR
5. WATER HEATER MUST HAVE SEISMIC STRAP OR TIE-DOWN.
6. COMBUSTION AIR IS REQ'D FOR ALL FUEL BURNING APPLIANCES. CONTRACTOR SHALL PROVIDE PROPER SIZE AND LOCATION AND MUST DEFINE SOURCE AND TERMINATION POINTS.
7. WATER CLOSETS MUST HAVE A MAX. OF 18 GALLON PER FLUSH FLOW RATE AND SHOWERS MUST BE EQUIPPED WITH SHOWER HEADS HAVING A FLOW RATE NO GREATER GREATER THAN 2.5 GALLONS PER MINUTE.
8. PROVIDE A #8 TYPE X SHEET ROCK FIRE BREAK BETWEEN GARAGE AND HOUSE.
9. ALL ELECTRICAL SERVICES AND METAL PIPING (INCLUDING GAS) MUST BE BONDED.
10. THE TOPS OF HANDRAILS SHALL BE PLACED 34" AND NOT MORE THAN 38" ABOVE THE NOSING OF TREADS. ENDS SHALL BE RETURNED OR SHALL TERMINATE IN NEWEL POSTS OR SAFETY TERMINALS. THE HANDGRIP PORTION OF HANDRAILS SHALL BE NOT LESS THAN 1 1/4" NOR MORE THAN 2" IN CROSS-SECTION. HANDRAILS SHALL HAVE A SPACE OF NOT LESS THAN 1 1/4" BETWEEN THE WALL AND HANDRAIL.
12. SHOWER DOORS MUST SWING OUT AND BE TEMPERED GLASS. SHOWERS MUST BE FINISHED TO A HEIGHT OF NOT LESS THEN 70" OF WATER PROOF MATERIAL.
17. ALL HEADERS OVER 6" SHALL BE SUPPORTED BY FRAMING ANCHORS OR JOIST HANGERS, UNLESS BEARING ON A BEAM, PARTITION OR WALL. TAIL JOISTS OVER 12" LONG TO BE SUPPORTED AT HEADER BY FRAMING ANCHORS OR ON LEDGER STRIPS NOT LESS THAN 2" x 2".
18. AT ALL VALLEYS AND HIPS, PROVIDE VALLEY OR HIP RAFTER NOT LESS THAN 2" THICK AND NOT LESS IN DEPTH THAN THE CUT END OF THE RAFTER
19. EXTERIOR WALL COVERING TO BE OF APPROVED TYPE. STUDS OF SHEATHING TO BE COVERED ON THE OUTSIDE FACE WITH A WEATHER RESISTANT BARRIER.
20. ENCLOSED ATTICS AND SPACES BETWEEN RAFTERS SHALL HAVE CLEAR CROSS - VENTILATION TO OUTSIDE VENTS. 1/300 OF SPACE VENTILATED FOR GABLE VENTS 1/300 OF SPACE VENTILATED FOR BOTH GABLE OR EVE VENTS.
21. PROVIDE COMFORT HEATING SYSTEM CAPABLE OF MAINTAINING 70F. TEMP THREE FEET ABOVE FLOOR LEVEL IN ALL ROOMS. HEATING APPLIANCES CANNOT BE LOCATED AS FOLLOWS:
 - IN ANY ROOM OR SPACE LESS THAN 12" WIDER THAN THE FURNACE, WITH A MIN. WORKING SPACE OF NOT LESS THAN 3" ALONG THE SIDES, BACK, AND TOP;
 - IN ANY ROOM TO BE DESIGNATED AS A BEDROOM, BATHROOM, CLOSET, OR IN ANY CONFINED SPACE WITH ACCESS ONLY THROUGH SUCH ROOMS.
22. PROVIDE ADEQUATE COMBUSTION AIR AT THE RATE OF 1" SQ. IN. PER 1000 BTU. COMBUSTION AIR MUST BE OBTAINED FROM THE OUTSIDE. COMBUSTION DUCTS MUST BE PROPERLY COVERED.
23. PROVIDE A 1" CLEARANCE BETWEEN CLASS B VENT AND COMBUSTION AIR DUCT.
24. WATER HEATER MUST BE INSTALLED IN PROPER LOCATIONS. (SAME AS FURNACE)
25. PROVIDE 30" CLEARANCE BETWEEN RANGE TOP TO COMBUSTIBLE MATERIALS.
26. COMBUSTIBLE MATERIALS SHALL NOT BE PLACED WITHIN ONE INCH OF FIREPLACE, OR SMOKE CHAMBER OF CHIMNEY WALLS. COMBUSTIBLE MATERIALS SHALL NOT BE PLACED WITHIN 6" OF FIREPLACE OPENING. NO SUCH COMBUSTIBLE MATERIAL SHALL PROJECT MORE THAN 18" FOR ON INCH CLEARANCE FROM SUCH OPENING.
27. ALL MASONRY AND CONCRETE CHIMNEY SHALL BE ANCHORED AT EACH FLOOR OR CEILING LINE MORE THAN 6" ABOVE GRADE.
28. FIREPLACE CHIMNEY SHALL PROTRUDE 2' ABOVE ANY PORTION OF ROOF OR BUILDING WITHIN 10' OF CHIMNEY.
29. USE 22 GA. TIES AT 16" O.C. EACH WAY FOR MASONRY TIE.
30. ELECTRICAL PANELS MUST COMPLY WITH 110 - 16 NEC. 30" WIDE X 36" DEPTH X 6'-6" HIGH
31. VENT DRYER TO EXTERIOR IN ACCORDENCE WITH IRC SECTION M1501.
32. USE MIN. OF 2" THICK REDWOOD PLANKS ON DECK.
33. PROVIDE EXTERIOR GRADE PLYWOOD FOR SOFFIT. (IF USED)
34. A THERMAL EXPANSION TANK MUST BE INSTALLED ADJACENT TO RESIDENTIAL WATER HEATER.
35. GAS LOGS SHALL BE PROVIDED WITH A SHUT OFF VALVE OUTSIDE OF THE FIREBOX AND WITHIN 6" OF THE APPLIANCE, IN THE SAME ROOM OR A REMOTE LOCATION FROM THE APPLIANCE WHERE SUCH VALVES ARE PROVIDED WITH READY ACCESS. SUCH VALVES SHALL BE PERMANENTLY IDENTIFIED AND SHALL SERVE NO OTHER EQUIPMENT.
36. SPECIFICS ON FIREPLACE EQUIPMENT WILL BE PROVIDED TO THE CITY BY THE HVAC CONTRACTOR.
37. AS PER CODE R703A, FLASHING & COUNTER FLASHING WILL BE USED AROUND WINDOWS & DOORS.


REVISIONS

PHILLIPS CONSTRUCTION
BRADY BIRD GENERAL NOTES
PAYSON, UTAH

8885 SOUTH 3200 WEST
Spanish Fork, UT 84660
801-794-3738
Web: www.ddesignconcepts.com

Design Concepts Inc.

D & D

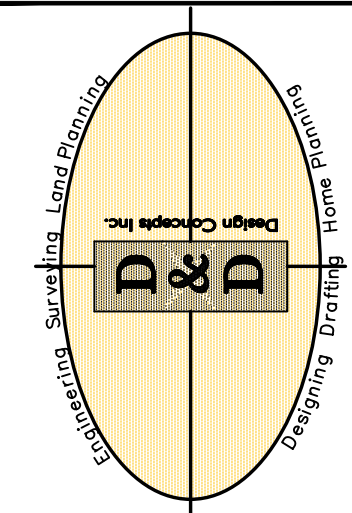

DRAWN BY:

PD

DATE:

08/25

SCALE:


NONE

PROJECT #

2K2525

SHEET #

1 OF 9

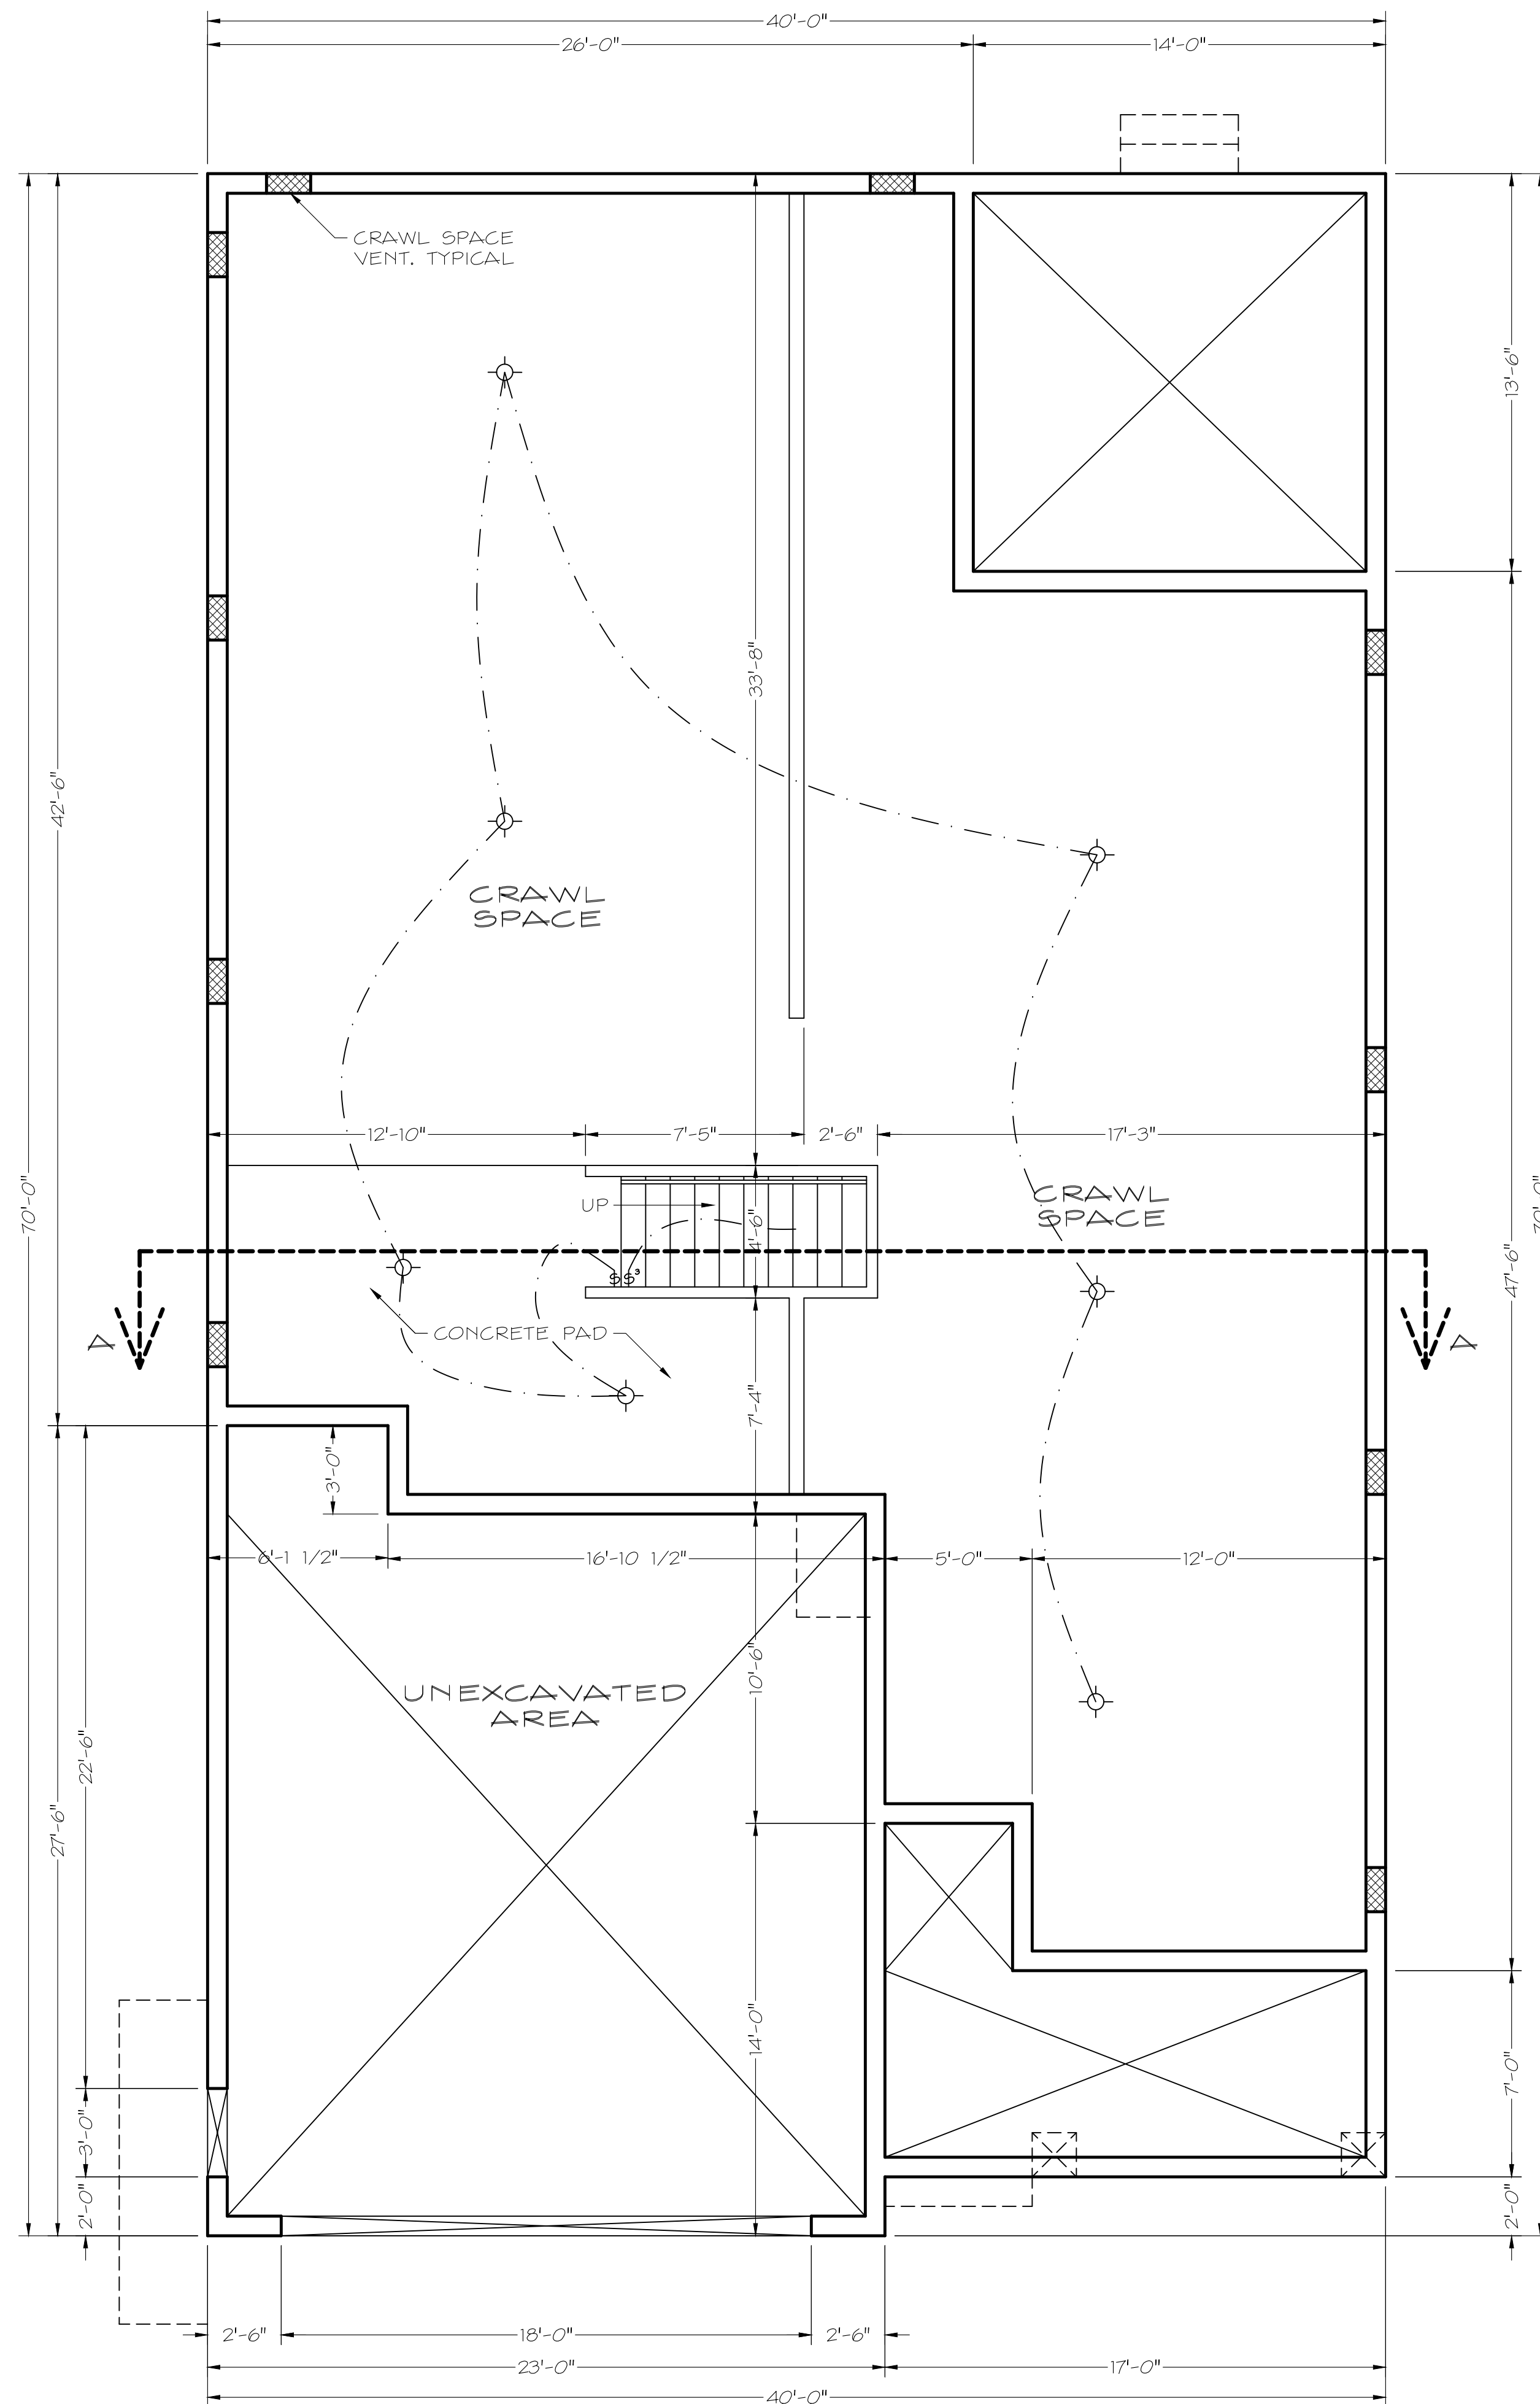

NOTE:


1. KING STUD & TRIMMER TO SUPPORT ALL HEADERS UNLESS SPECIFIED
2. ALL GIRDER TRUSSES TO BE SUPPORTED BY (3) 2X6 COLUMN UNLESS SPECIFIED. LOAD MUST TRANSFER TO FOUNDATION WALL.
3. TRUSS LAYOUT TO BE VERIFIED BY TRUSS MANUFACTURE. IF DESIGN DIFFERS FROM STAMPED PLANS – ENGINEER MUST BE NOTIFIED.

LEGEND	
	110 VOLT OUTLET
	220 VOLT OUTLET
	GFCI OUTLET
	1/2 SWITCH OUTLET
	WATER PROOF GFCI
	CEILING OUTLET
	EXT. SPOT LIGHT
	CEILING FIXTURE
	WALL FIXTURE
	RECESSED FIXTURE
	EXT. FLOOD LIGHT
	MOTION SENSOR
	PULL CHAN FIXT.
	FLOURESCENT FIXT.
	SWITCH
	3 WAY SWITCH
	4 WAY SWITCH
	RHEOSTAT SWITCH
	EXHAUST FAN
	SMOKE DETECTOR
	SMO./CO DETECTOR
	TELEPHONE JACK
	TELEVISION JACK
	DOOR CHIMES
	INTERCOMME
	THERMOSTAT
	CENTRAL VAC
	BREAKER PANEL
	SUB PANEL
	METER BOX
	FLOOR DRAIN
	HOSE BIBB
	CLG. FAN LIGHT COMBO

[illegible]


8385 SOUTH 3200 WEST
SPANISH FORK, UT 84660
801-794-3738
Web: www.dddesignconcepts.com

STRUCTURAL DETAILS AND
SCHEDULES APPEAR ON
SHEETS S501 & S601

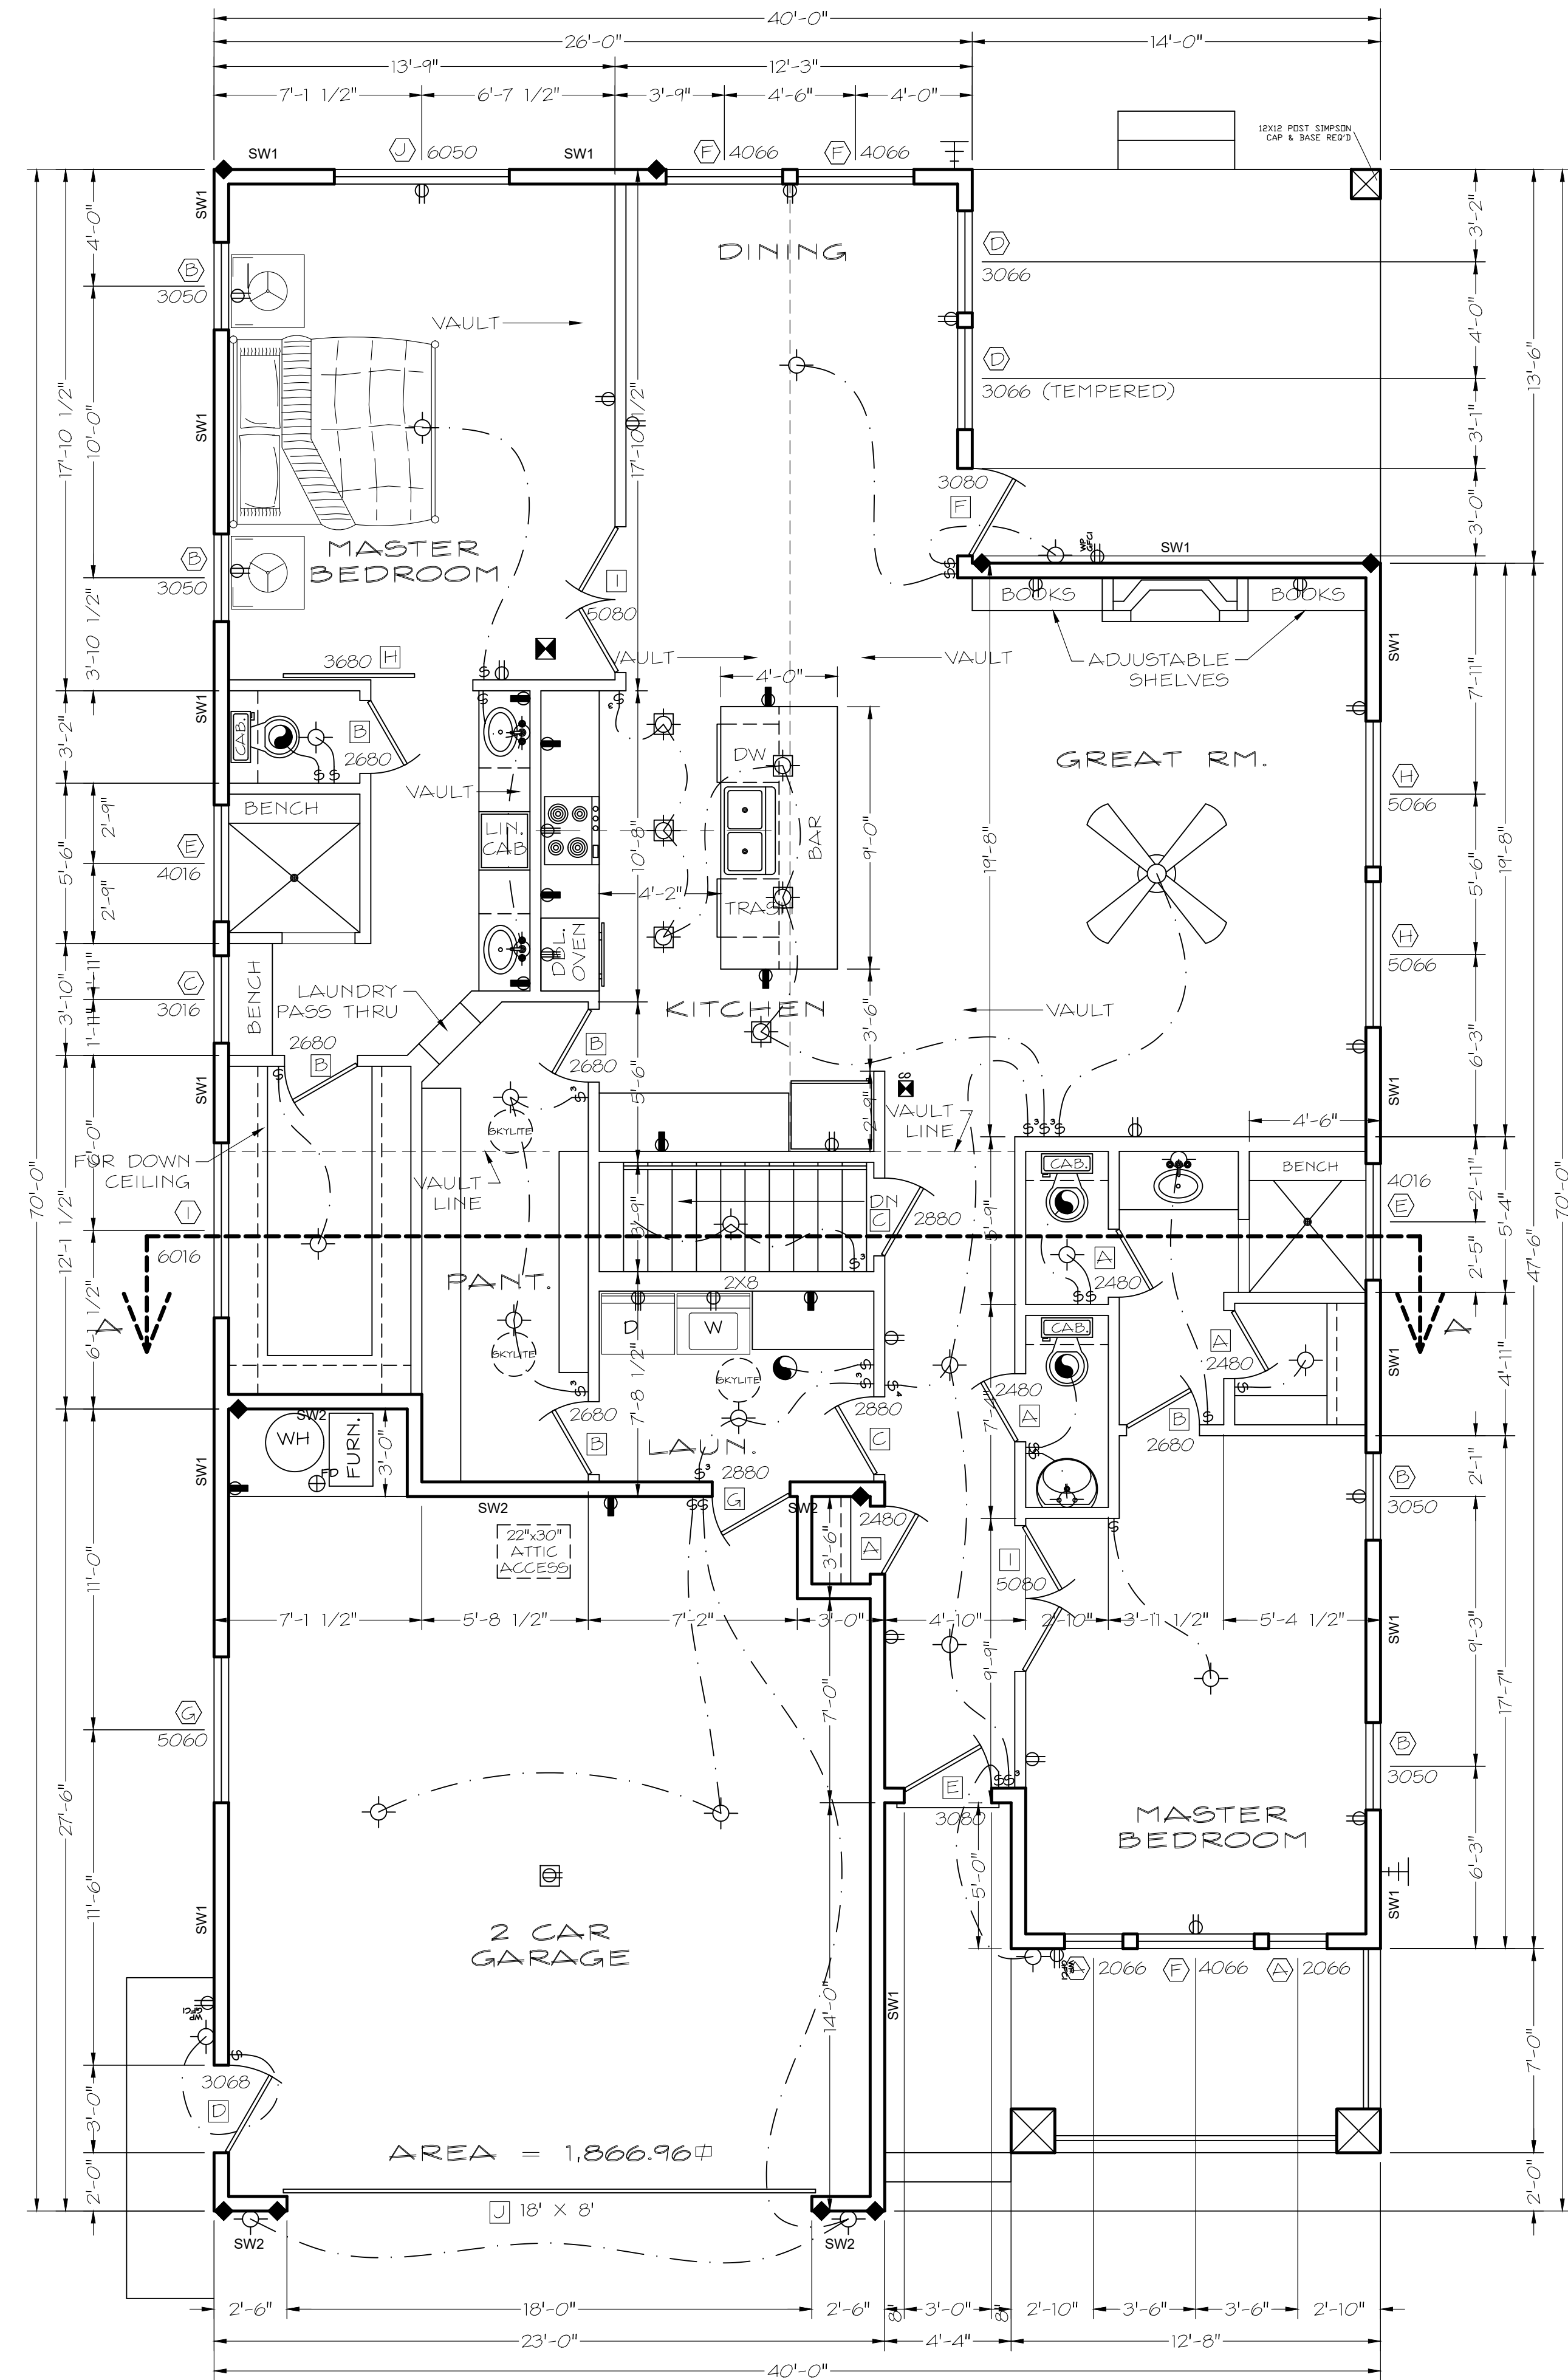

NOTE:

1. KING STUD & TRIMMER TO SUPPORT ALL HEADERS UNLESS SPECIFIED
2. ALL GIRDER TRUSSES TO BE SUPPORTED BY (3) 2X6 COLUMN UNLESS SPECIFIED. LOAD MUST TRANSFER TO FOUNDATION WALL.
3. TRUSS LAYOUT TO BE VERIFIED BY TRUSS MANUFACTURE. IF DESIGN DIFFERS FROM STAMPED PLANS - ENGINEER MUST BE NOTIFIED.

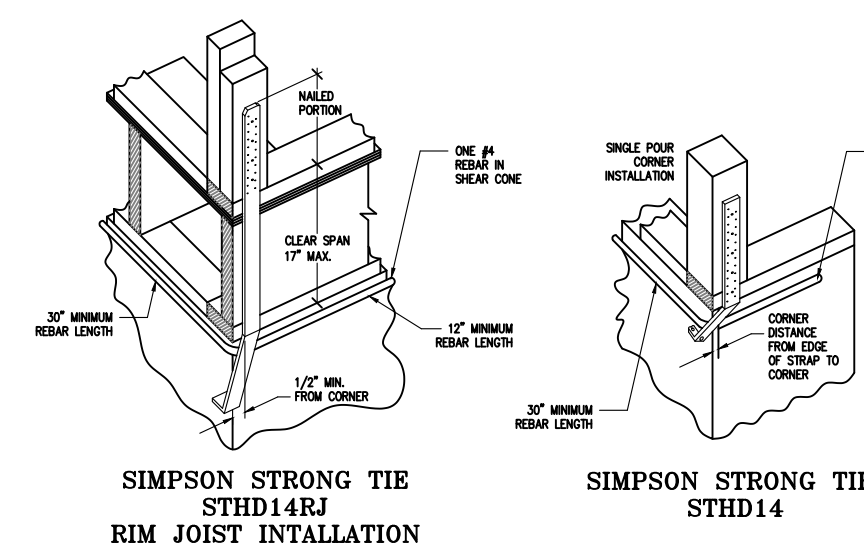

LEGEND	
	110 VOLT OUTLET
	220 VOLT OUTLET
	GFCI OUTLET
	1/2 SWITCH OUTLET
	WATER PROOF GFCI
	CEILING OUTLET
	EXT. SPOT LIGHT
	CEILING FIXTURE
	WALL FIXTURE
	RECESSED FIXTURE
	EXT. FLOOD LIGHT
	MOTION SENSOR
	PULL CHAN FIXT.
	FLOURECENT FIXT.
	SWITCH
	3 WAY SWITCH
	4 WAY SWITCH
	RHEOSTAT SWITCH
	EXHAUST FAN
	SMOKE DETECTOR
	SMO/CO DETECTOR
	TELEPHONE JACK
	TELEVISION JACK
	DOOR CHIMES
	INTERCOM
	THERMOSTAT
	CENTRAL VAC
	BREAKER PANEL
	SUB PANEL
	METER BOX
	FLOOR DRAIN
	HOSE BIBB
	CLG. FAN LIGHT COMBO

9'-0" WALLS TYP.

REVISIONS

PHILLIPS CONSTRUCTION

BRADY BIRD MAIN FLOOR PLAN

PAYSON, UTAH

8385 SOUTH 3200 WEST

SPANISH FORK, UT 84660

801-794-3738

Web: www.ddesignconcepts.com

Design Concepts Inc.

D & D

DRAWN BY:

JM

DATE:

08/25

SCALE:



1/4" = 1' - 0"

PROJECT #

2K2525

SHEET #

3 OF 9

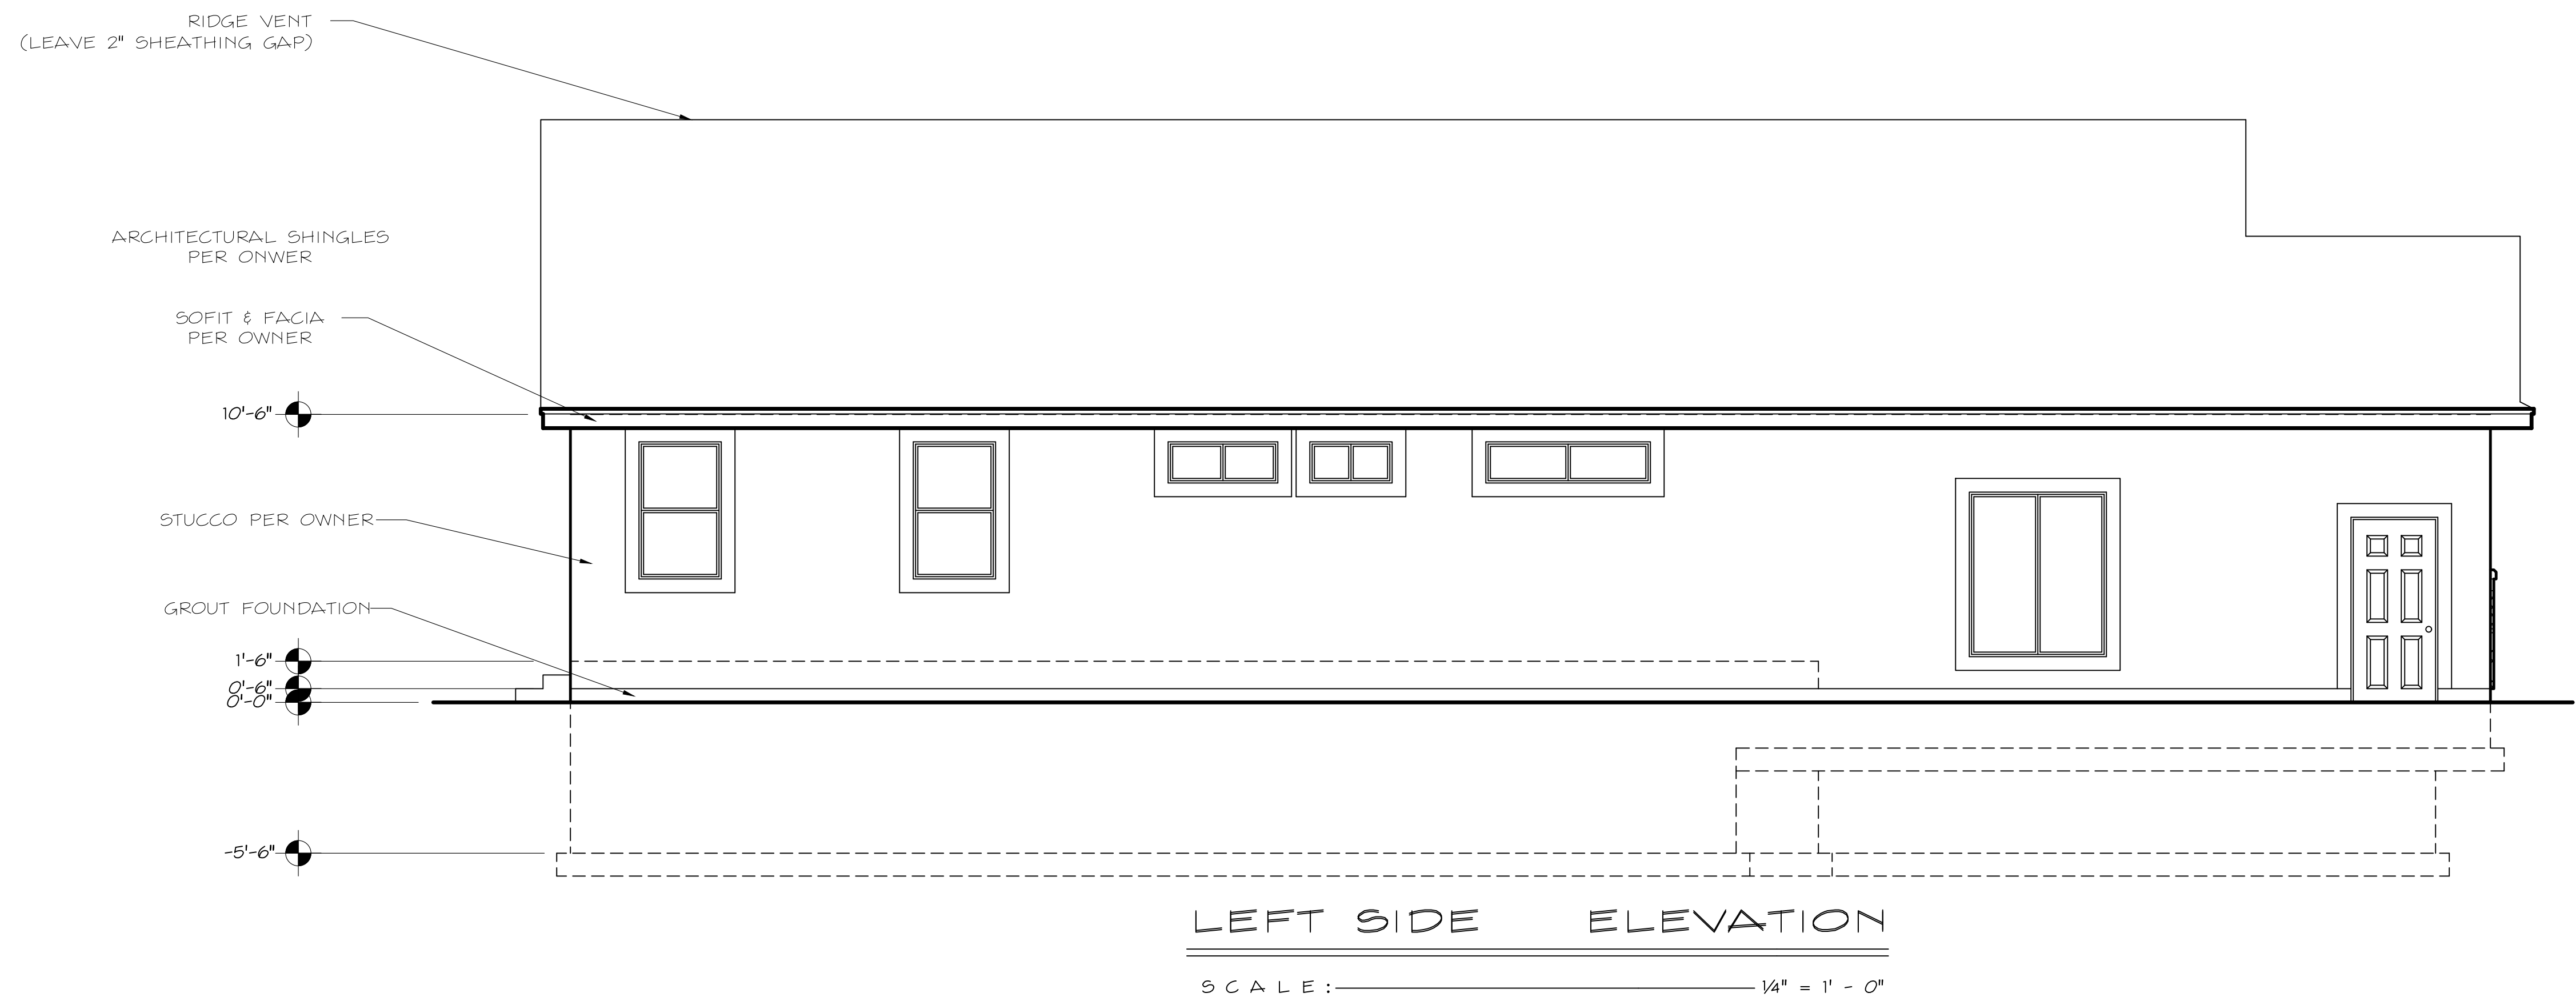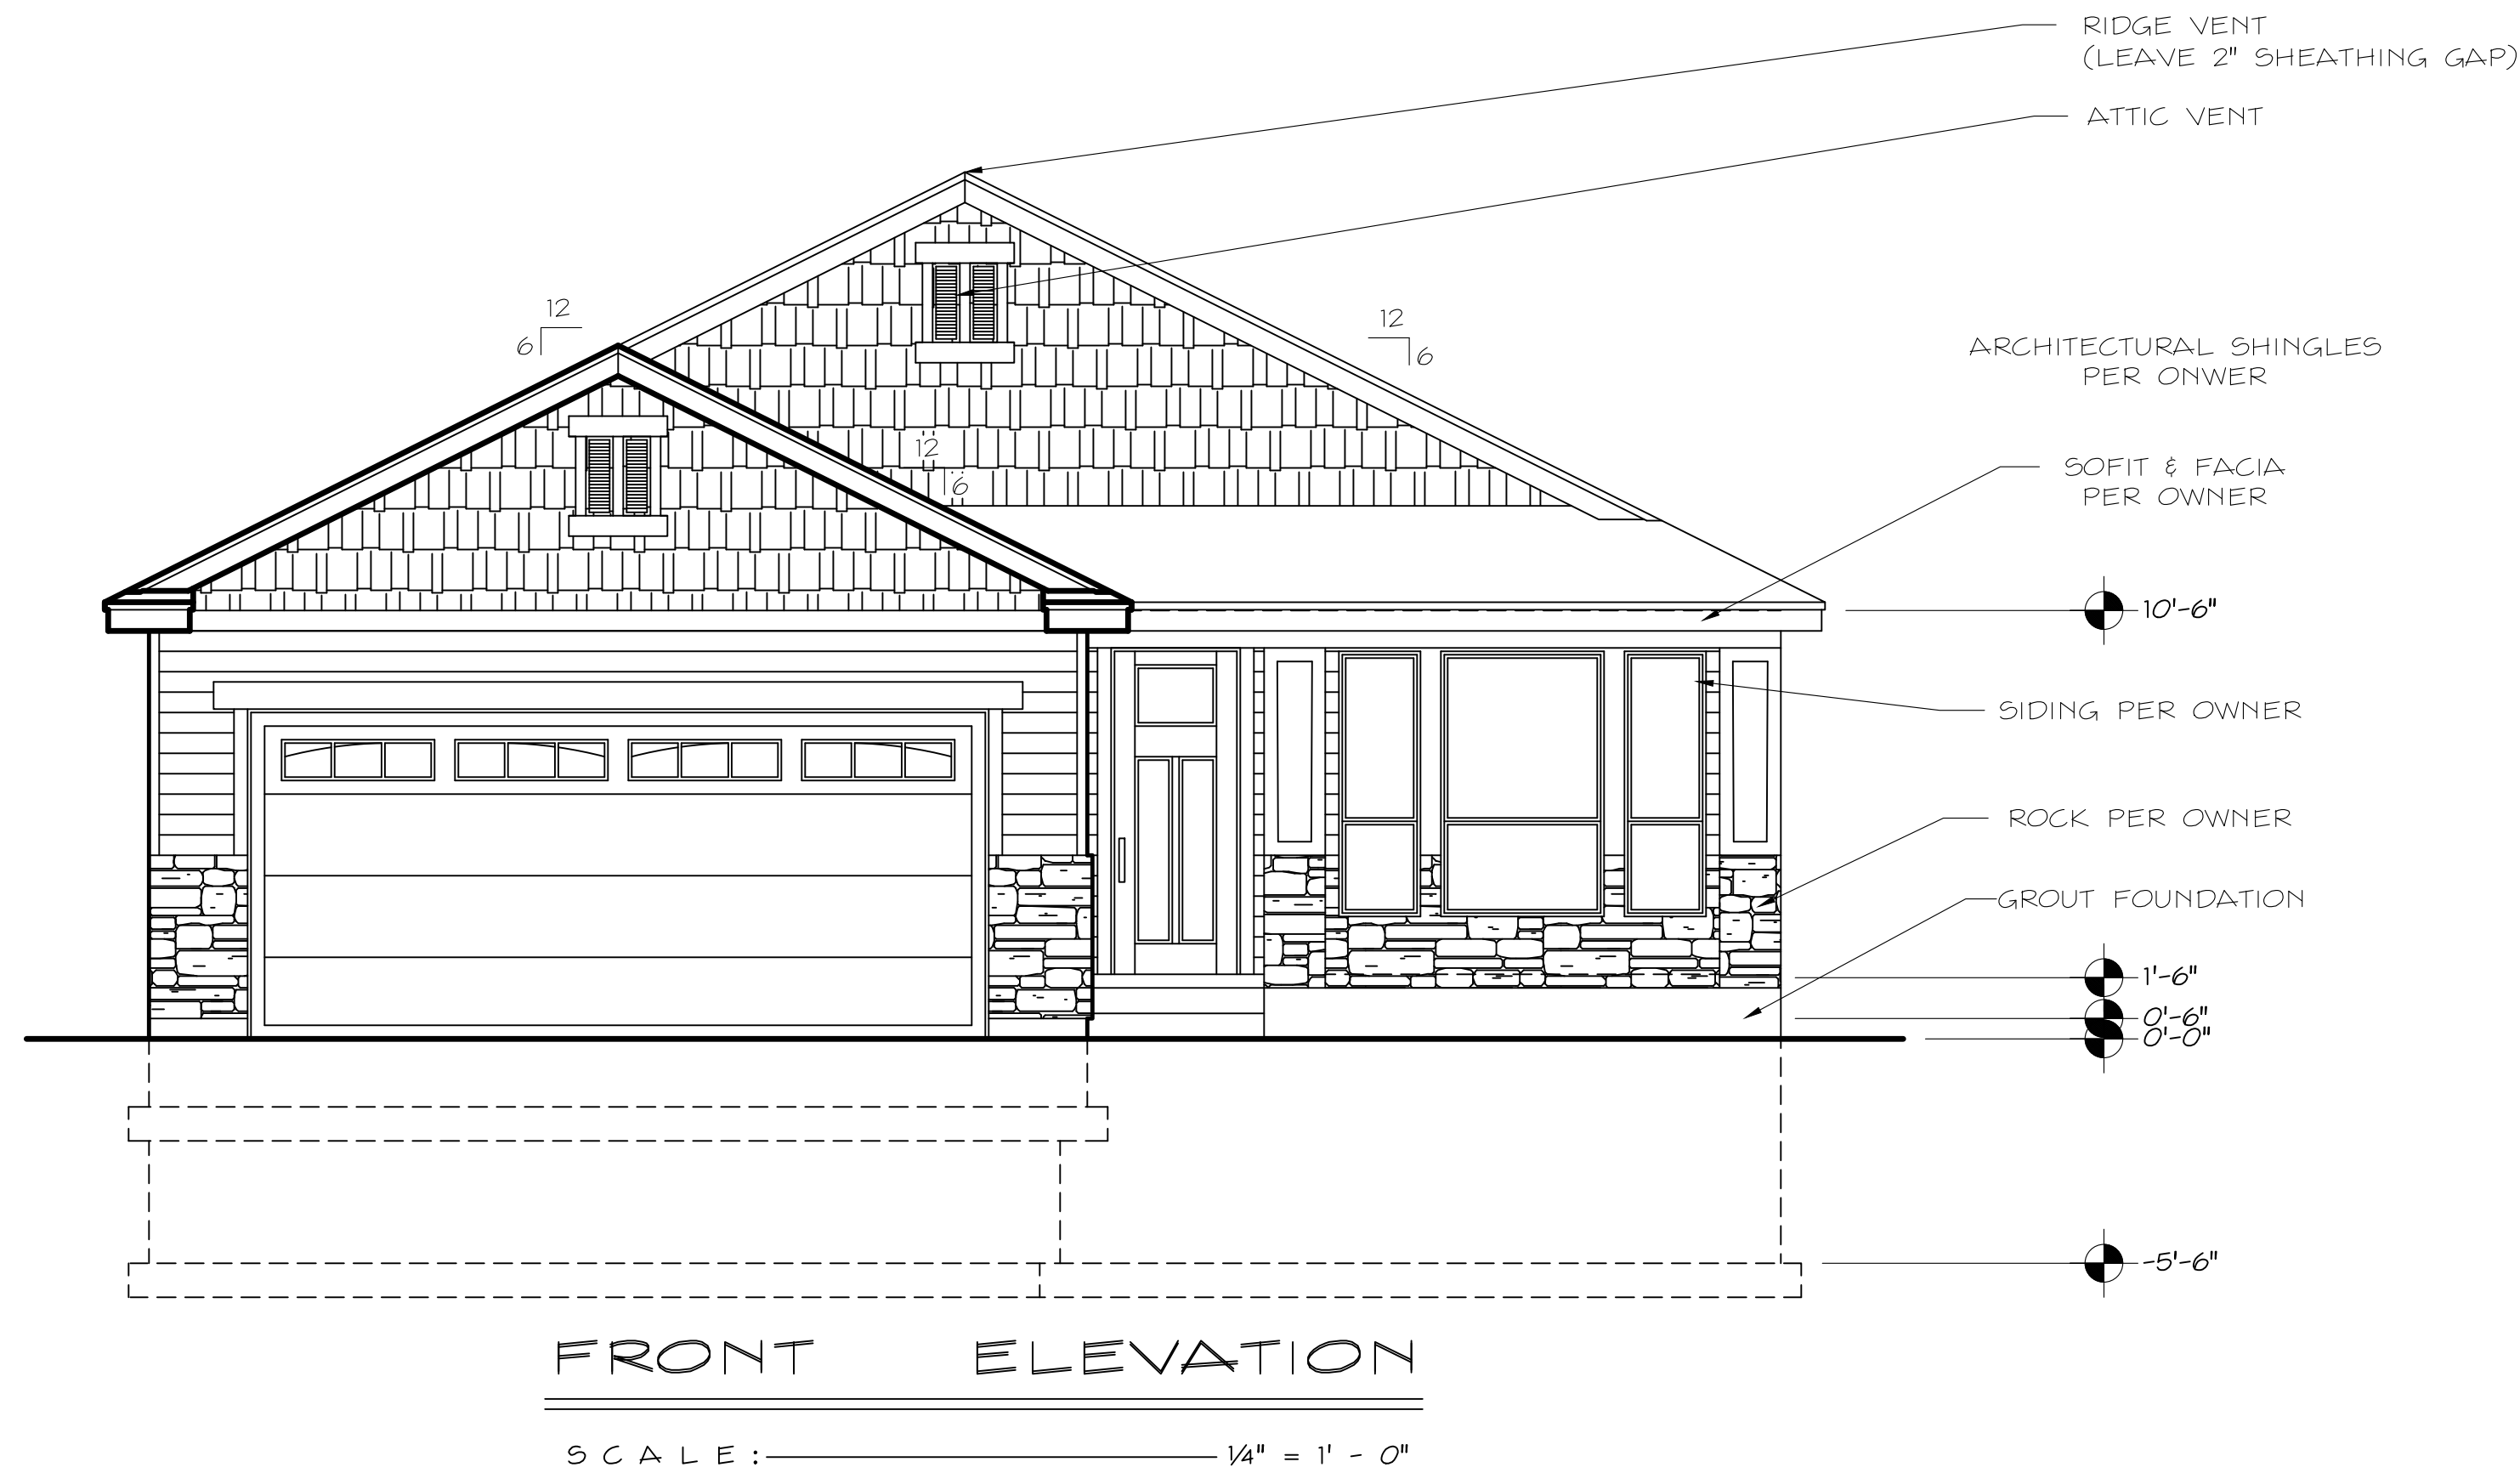

REVISIONS

PHILLIPS CONSTRUCTION
BRADY BIRD ELEVATIONS
PAYSON, UTAH

8385 SOUTH 3200 WEST
SPANISH FORK, UT 84660
801-794-3738
Web: www.dddesignconcepts.com


Design Concepts Inc.

D & D

DRAWN BY: JM
DATE: 08/25
SCALE: 1/4" = 1' - 0"
PROJECT # 2K2525
SHEET #

4 OF 9

STRUCTURAL DETAILS AND
SCHEDULES APPEAR ON
SHEETS S501 & S601

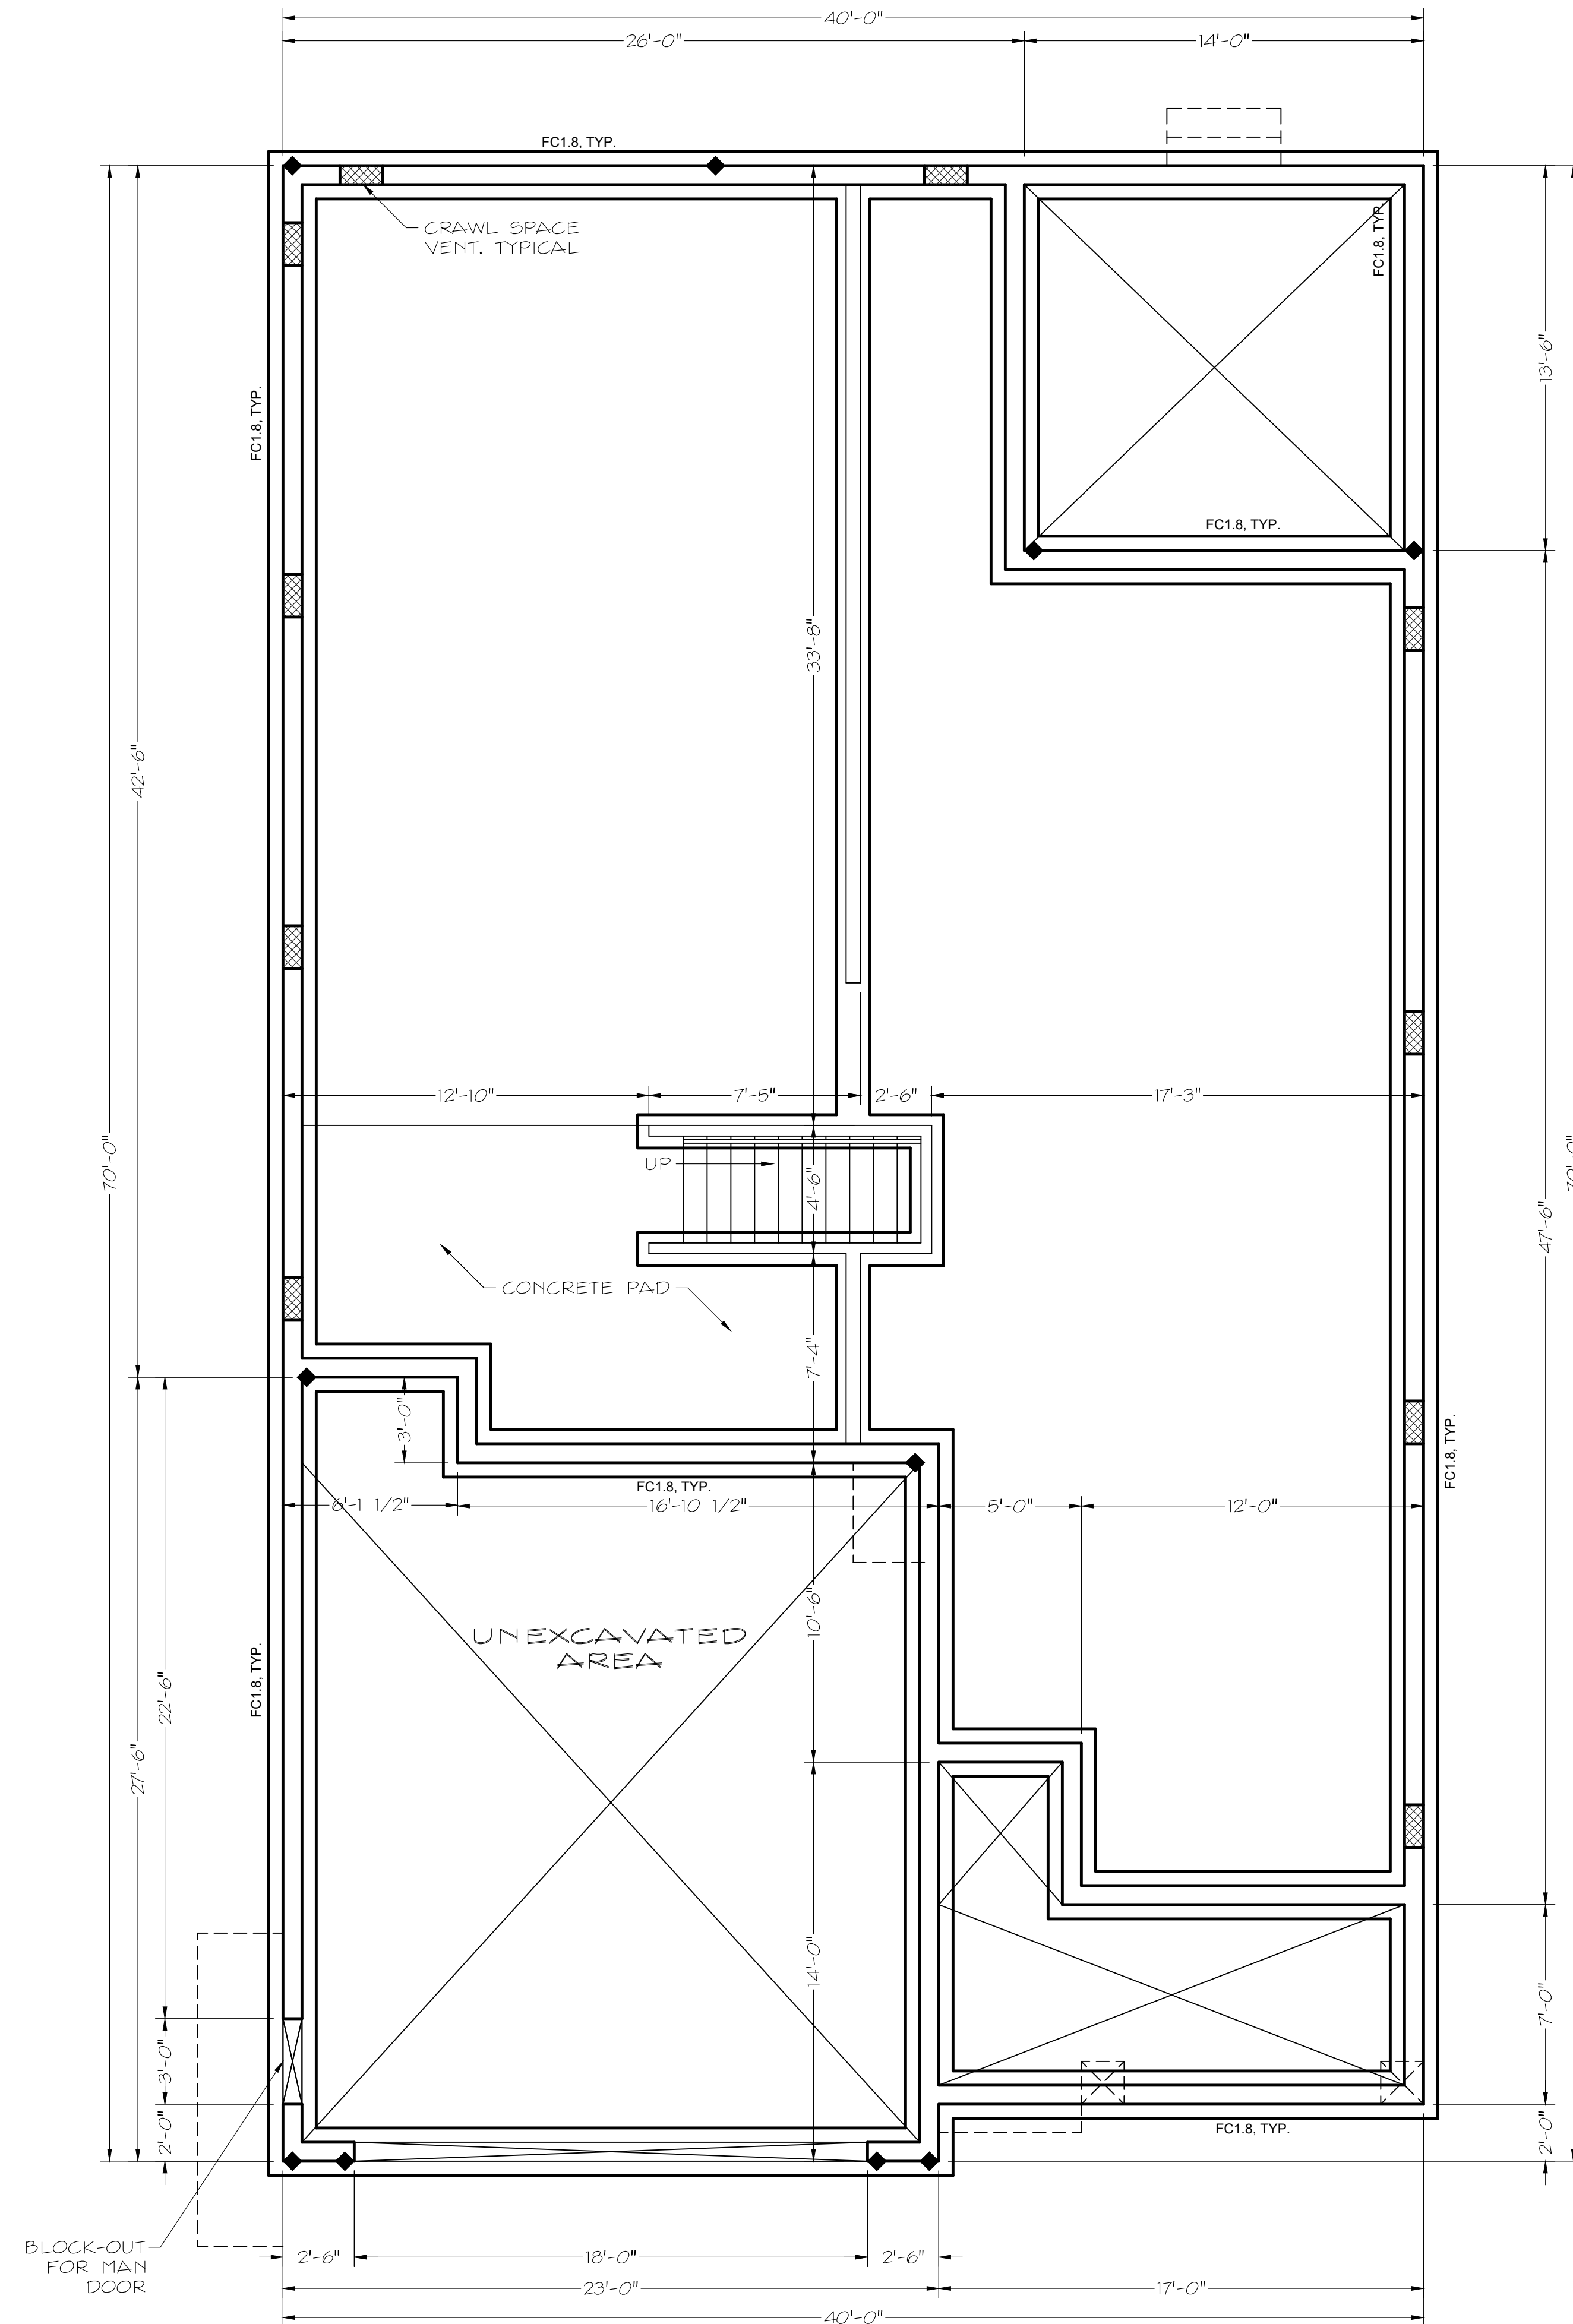


8"x10' FOUNDATION WALL
VERT.: #5 REBAR @ 12" O.C.
HORIZ.: (8) #4 REBAR EVENLY SPACED

FOOTINGS:
10"X20" WITH (2) #4 BARS CONTINUOUS

NOTE:


1. KING STUD & TRIMMER TO SUPPORT ALL HEADERS UNLESS SPECIFIED
2. ALL GIRDER TRUSSES TO BE SUPPORTED BY (3) 2X6 COLUMN UNLESS SPECIFIED. LOAD MUST TRANSFER TO FOUNDATION WALL.
3. TRUSS LAYOUT TO BE VERIFIED BY TRUSS MANUFACTURE. IF DESIGN DIFFERS FROM STAMPED PLANS – ENGINEER MUST BE NOTIFIED.

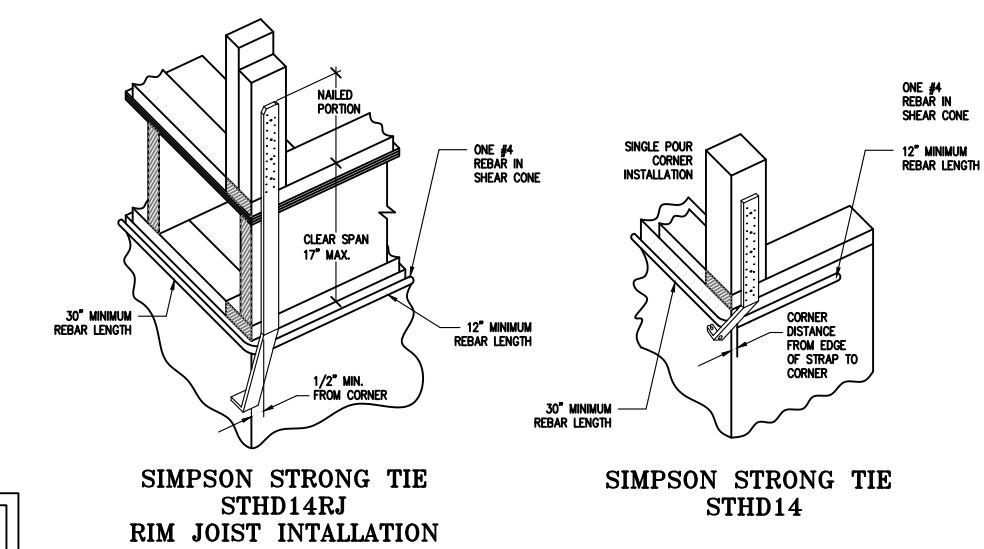

10'-0" FOUNDATION
WALLS TYP.

[illegible]

STRUCTURAL DETAILS AND
SCHEDULES APPEAR ON
SHEETS S501 & S601

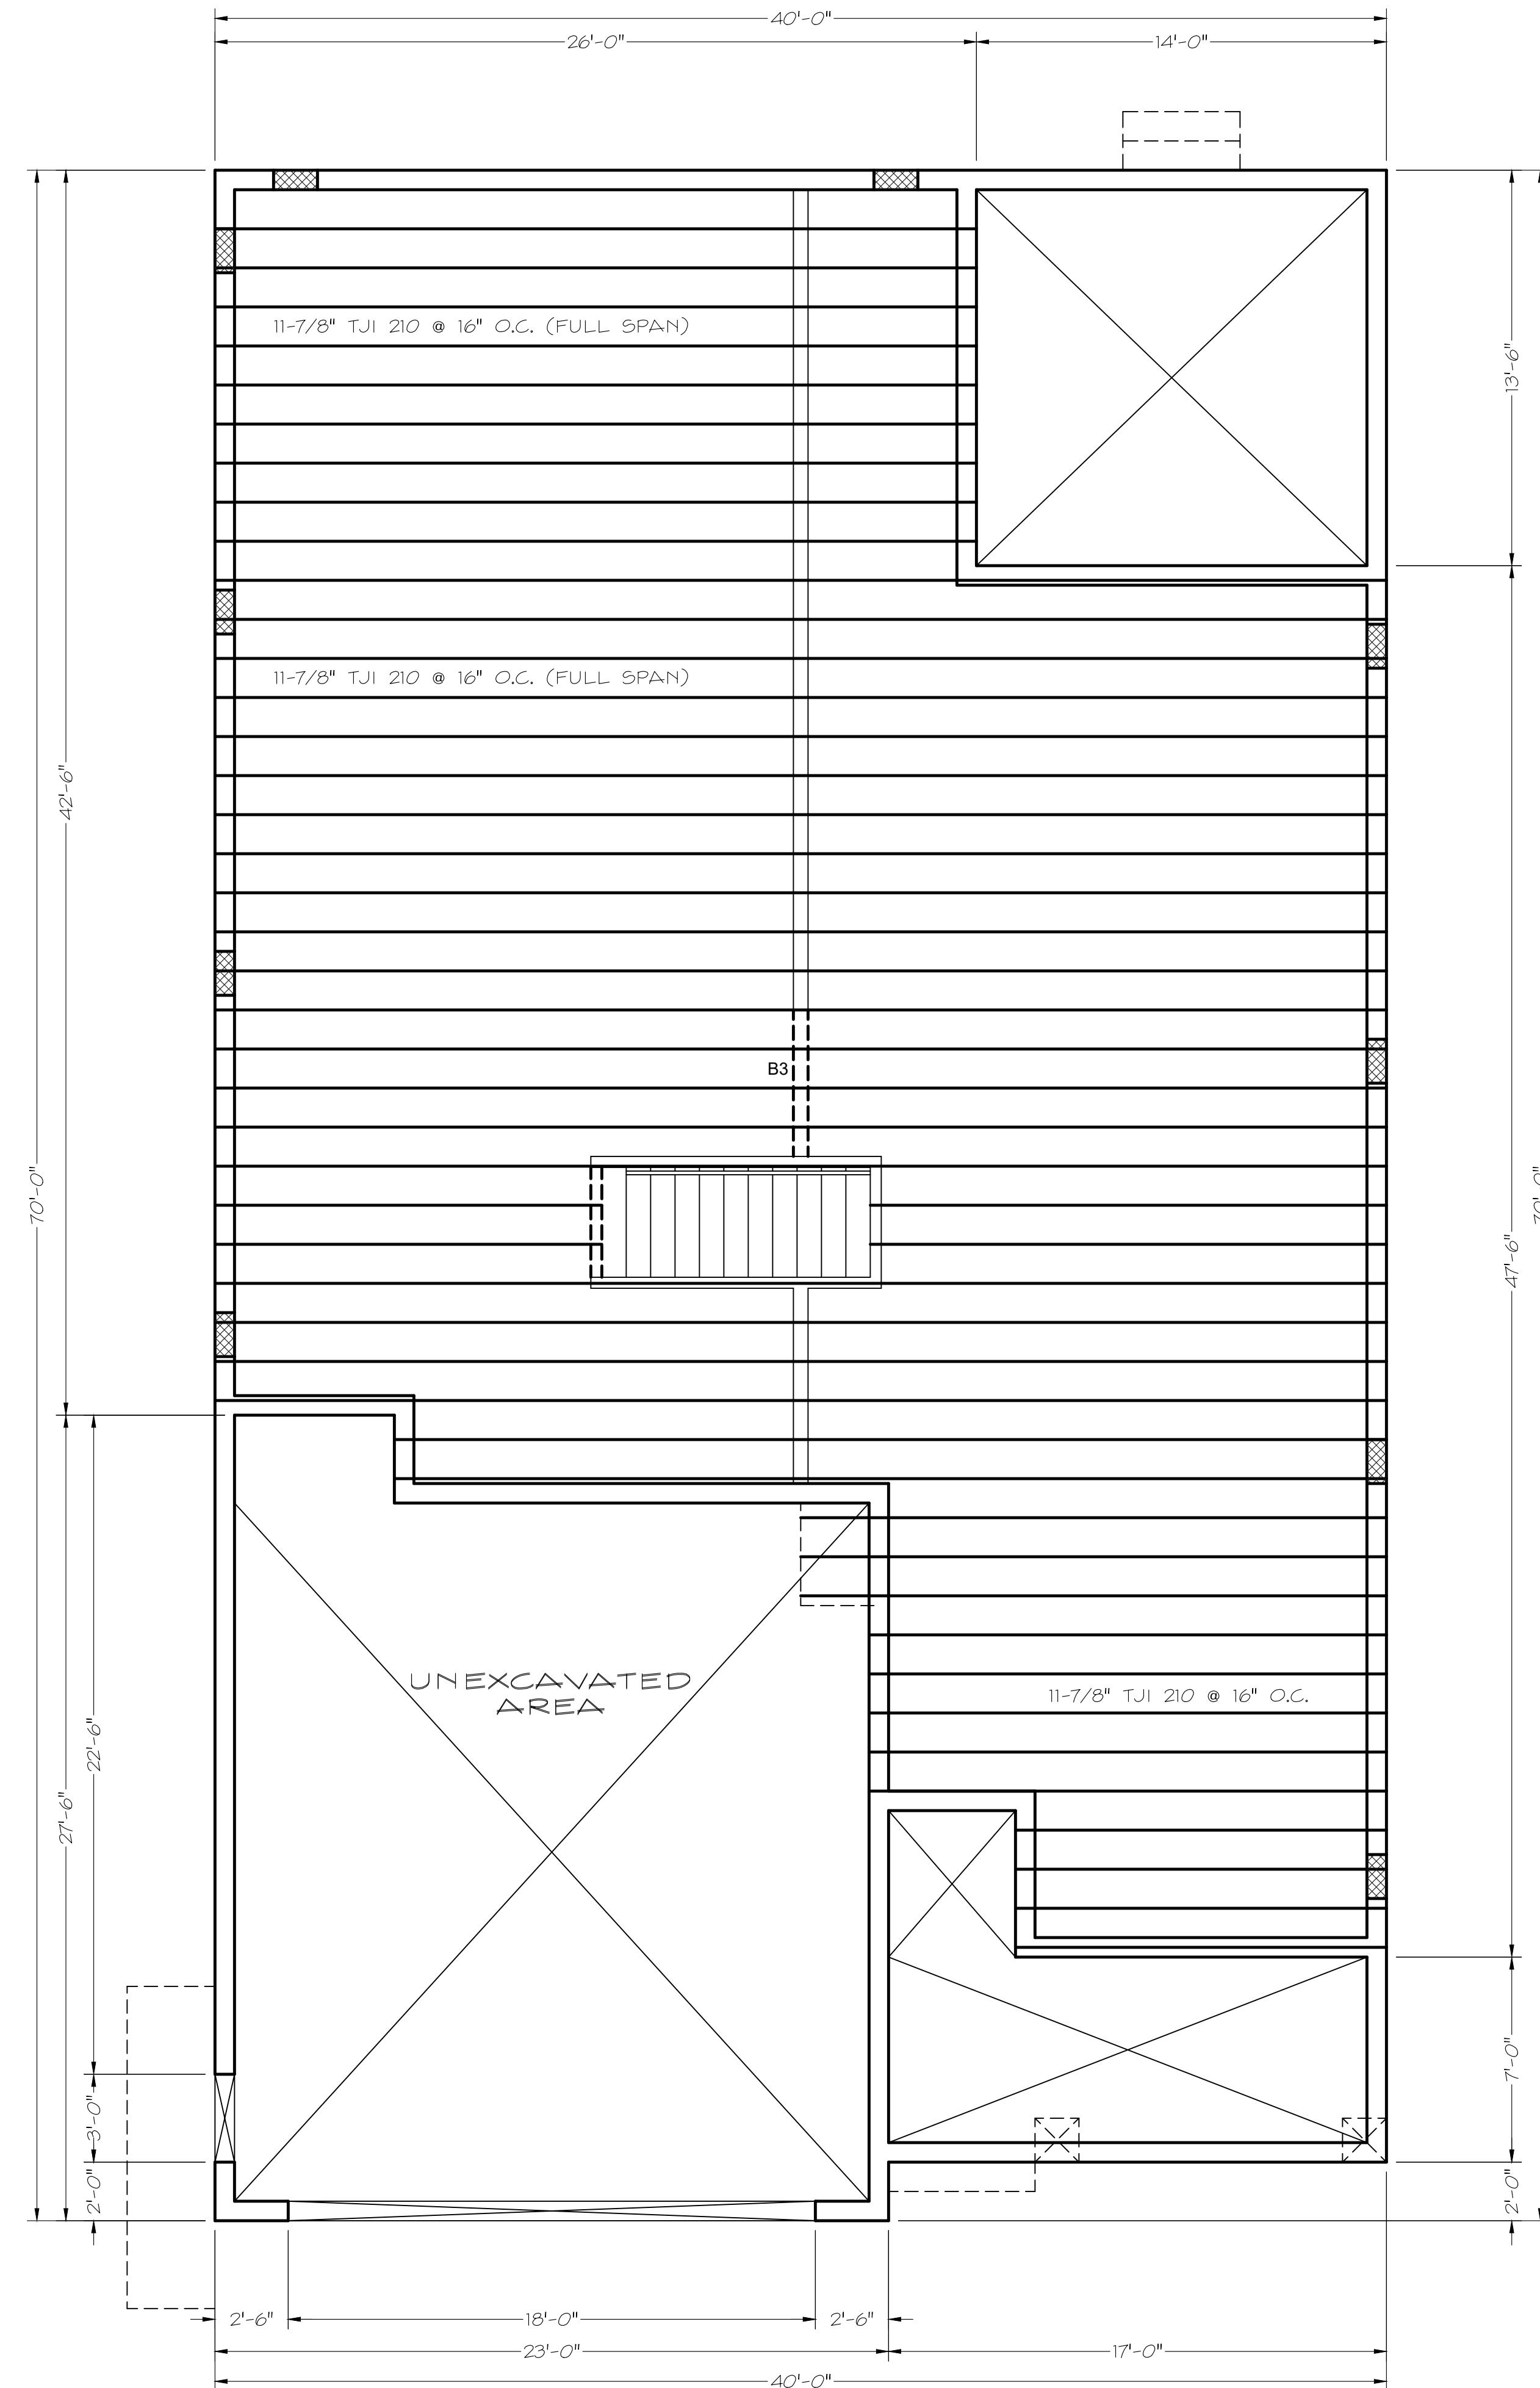

ALL OPENING HEADERS
ARE (2) 2"x8" U.N.O.

REVISIONS


PHILLIPS CONSTRUCTION
BRADY BIRD FLOOR FRAMING PLAN
PAYSON, UTAH

8385 SOUTH 3200 WEST
SPANISH FORK, UT 84660
801-794-3738
Web: www.ddesignconcepts.com

D&D

DRAWN BY:	JM
DATE:	08/25
SCALE:	1/4" = 1' - 0"
PROJECT #	2K2525
SHEET #	

STRUCTURAL DETAILS AND
SCHEDULES APPEAR ON
SHEETS S501 & S601


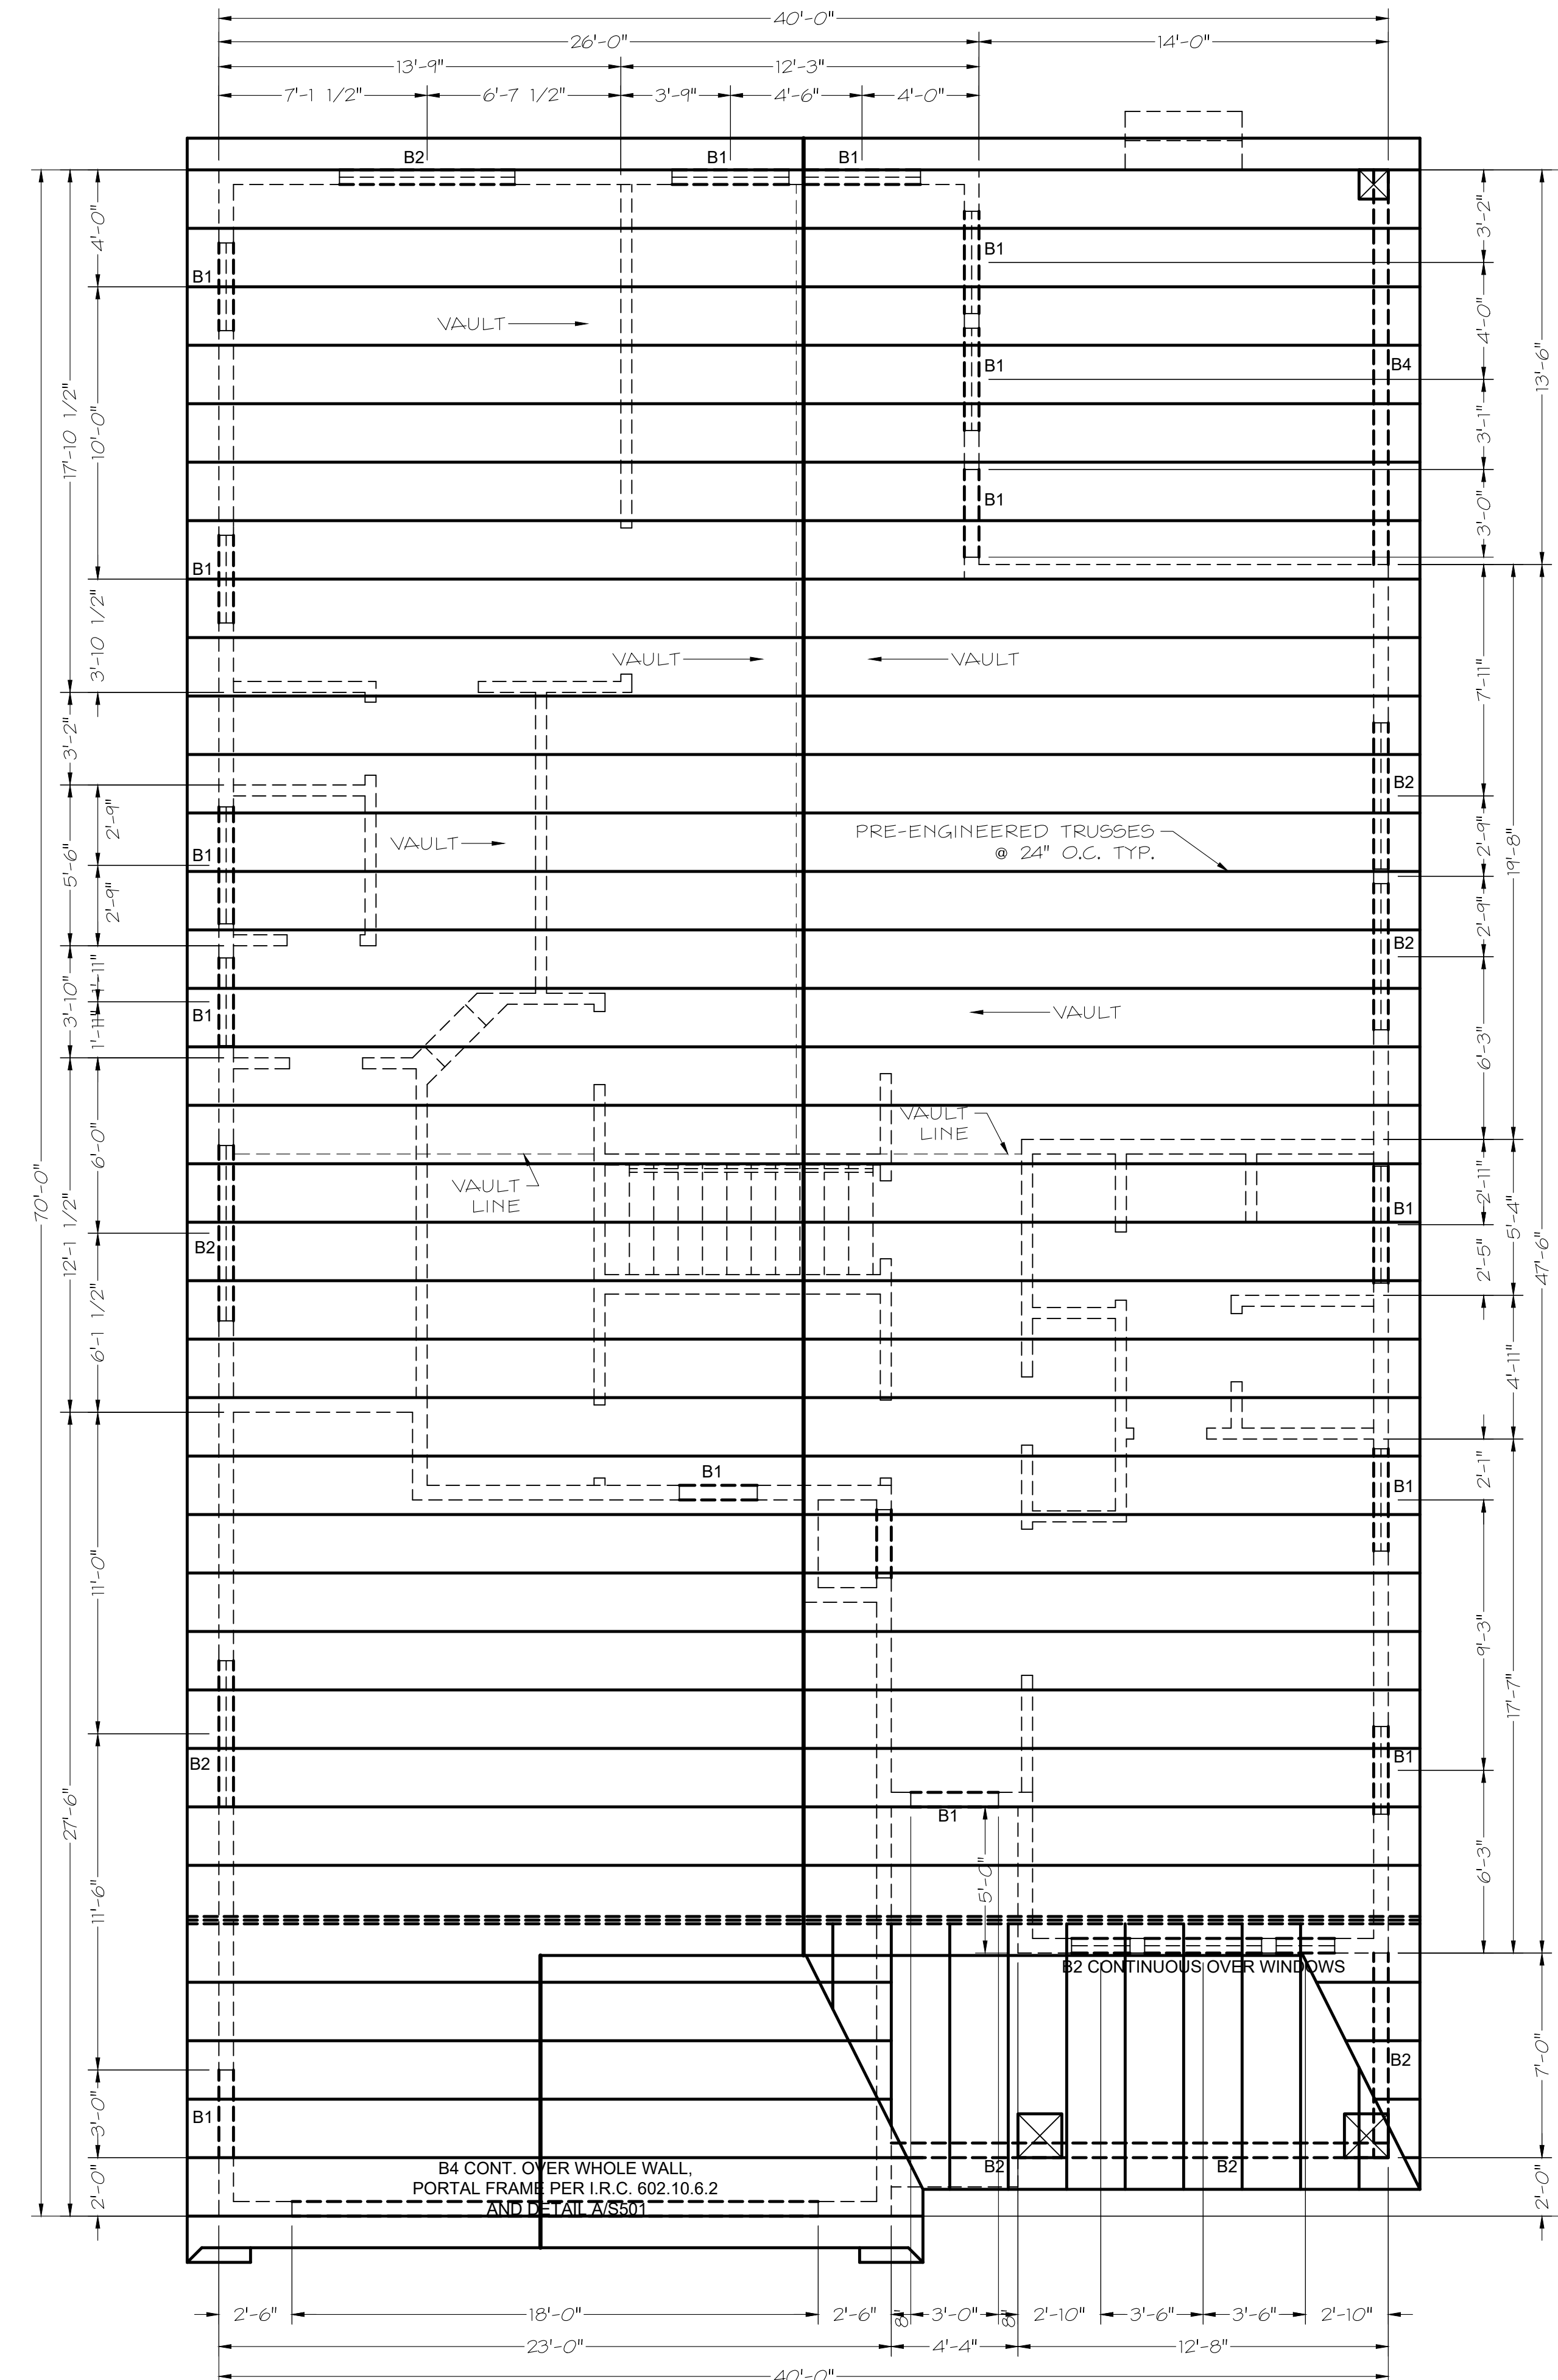


NOTE:

1. KING STUD & TRIMMER TO SUPPORT ALL HEADERS UNLESS SPECIFIED
2. ALL GIRDER TRUSSES TO BE SUPPORTED BY (3) 2X6 COLUMN UNLESS SPECIFIED. LOAD MUST TRANSFER TO FOUNDATION WALL.
3. TRUSS LAYOUT TO BE VERIFIED BY TRUSS MANUFACTURE. IF DESIGN DIFFERS FROM STAMPED PLANS - ENGINEER MUST BE NOTIFIED.

ALL OPENING HEADERS
ARE (2) 2"x8" U.N.O.

[illegible]

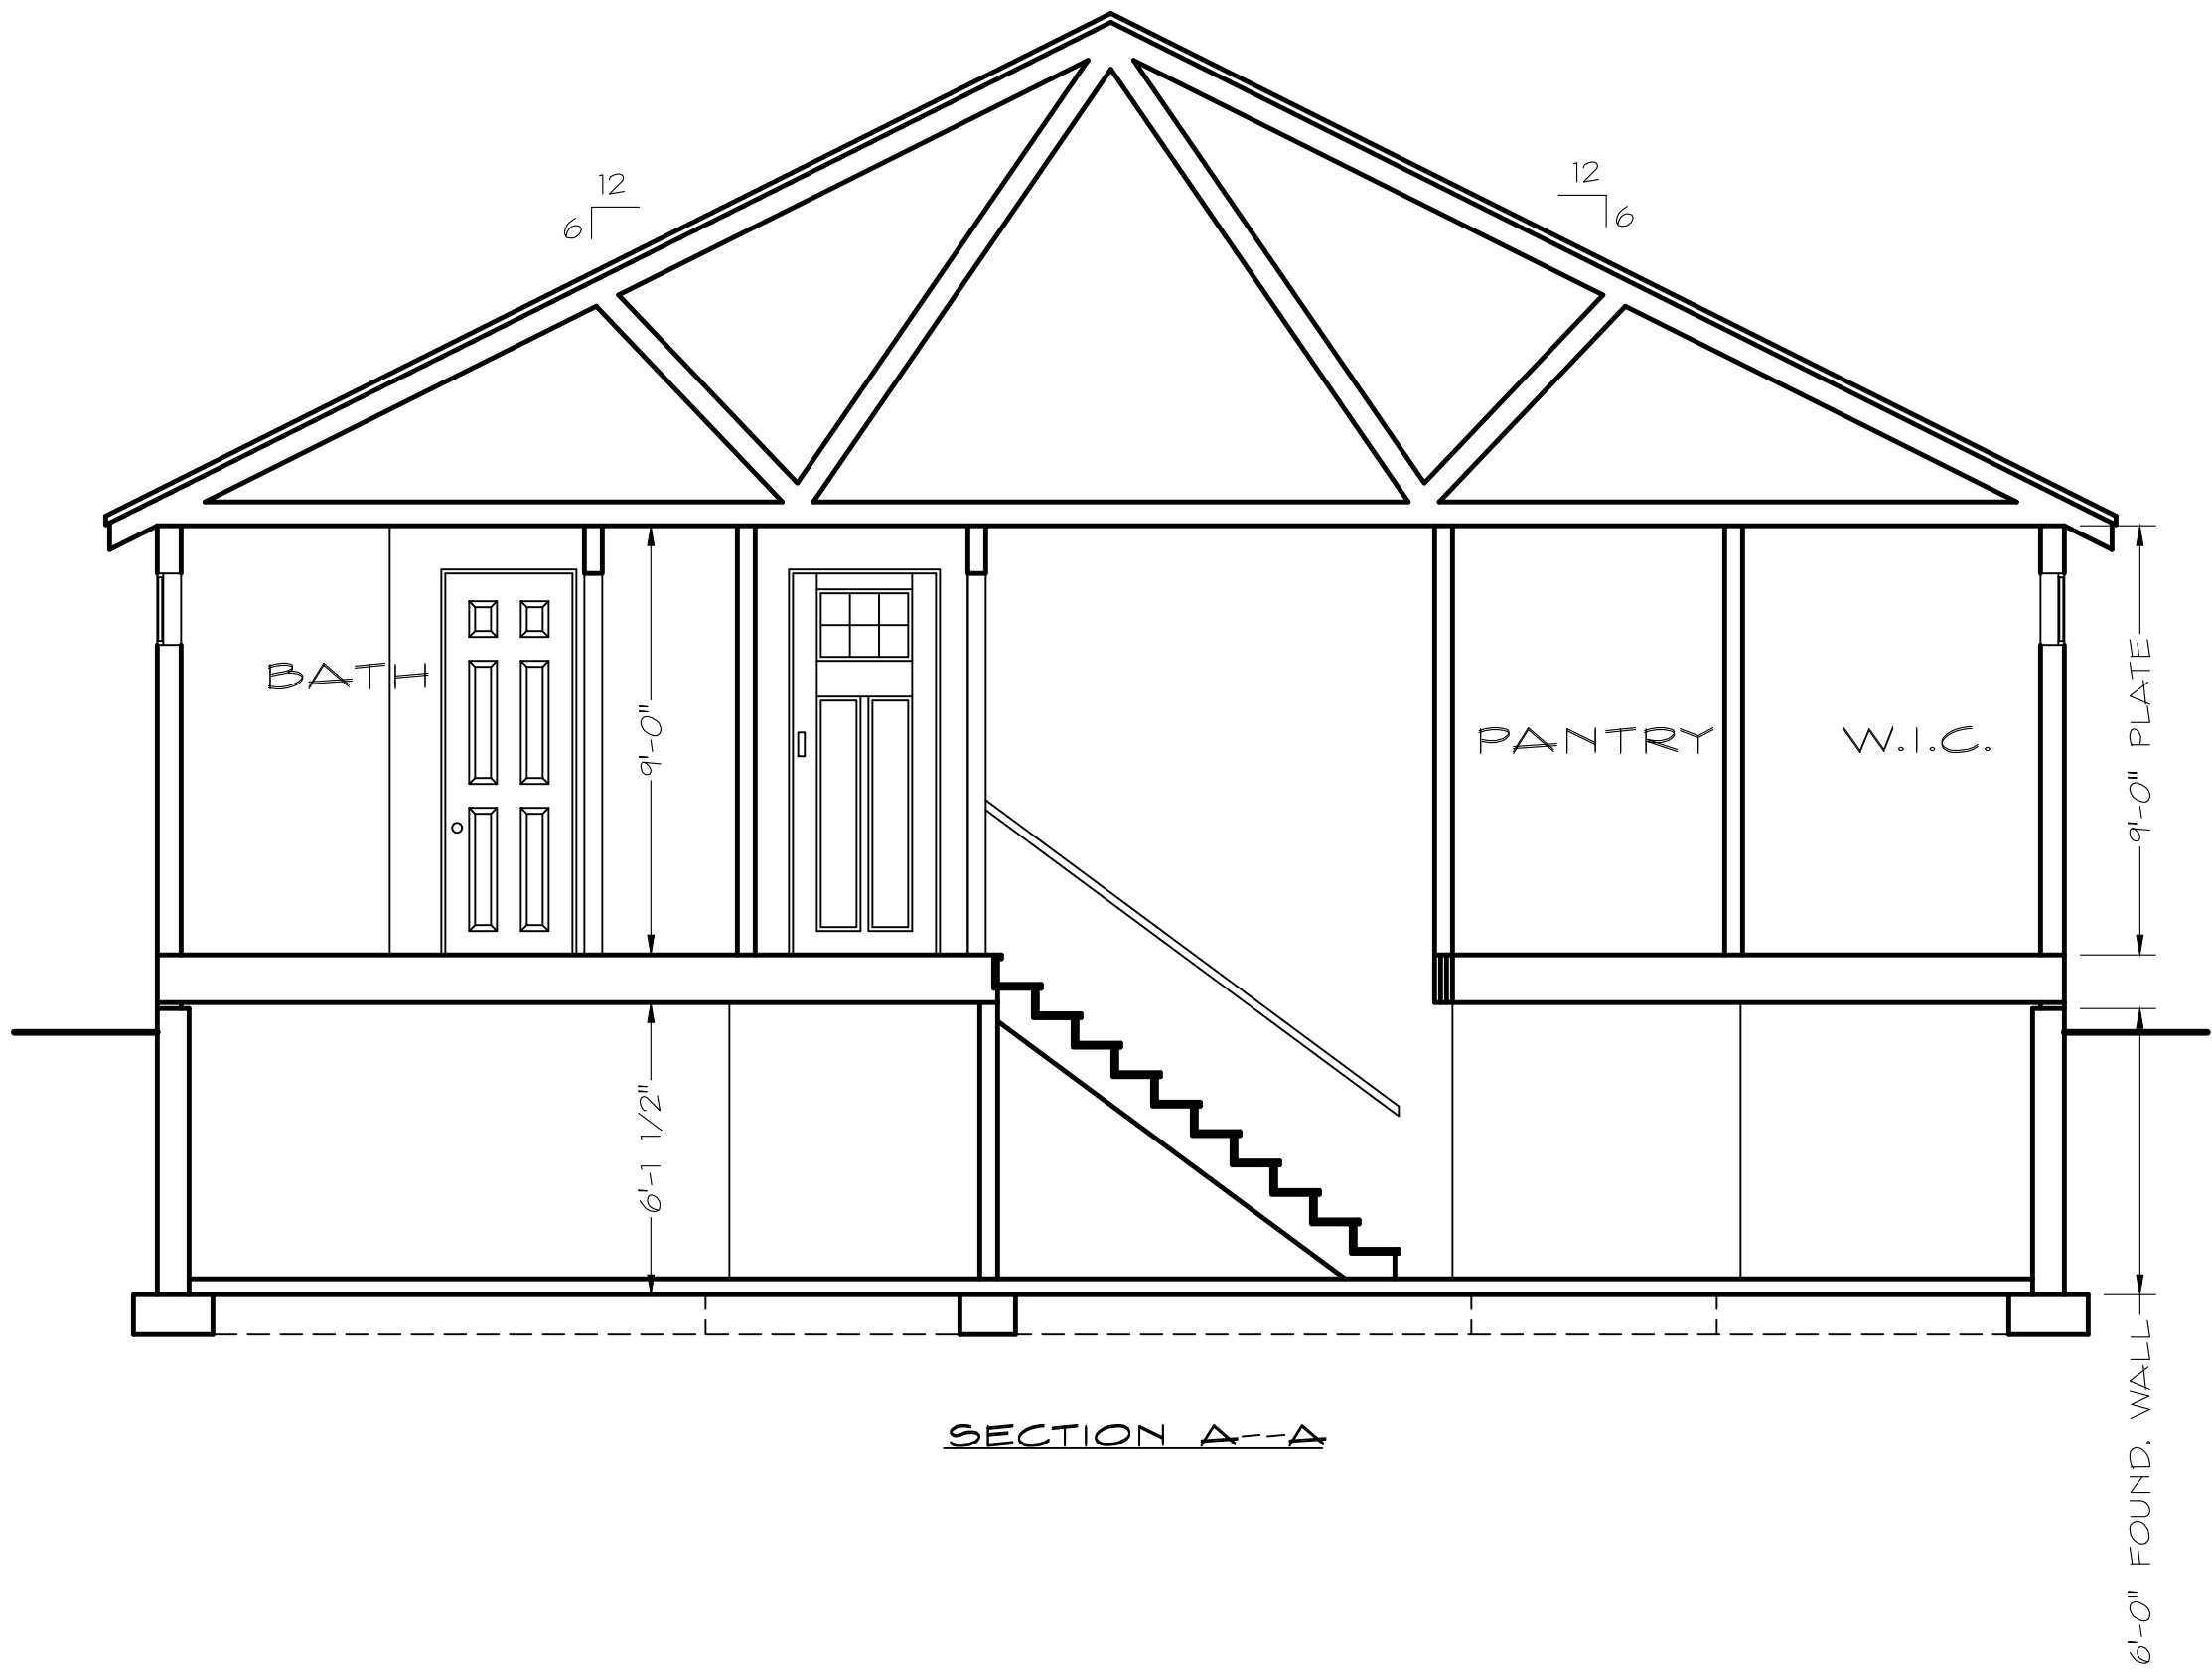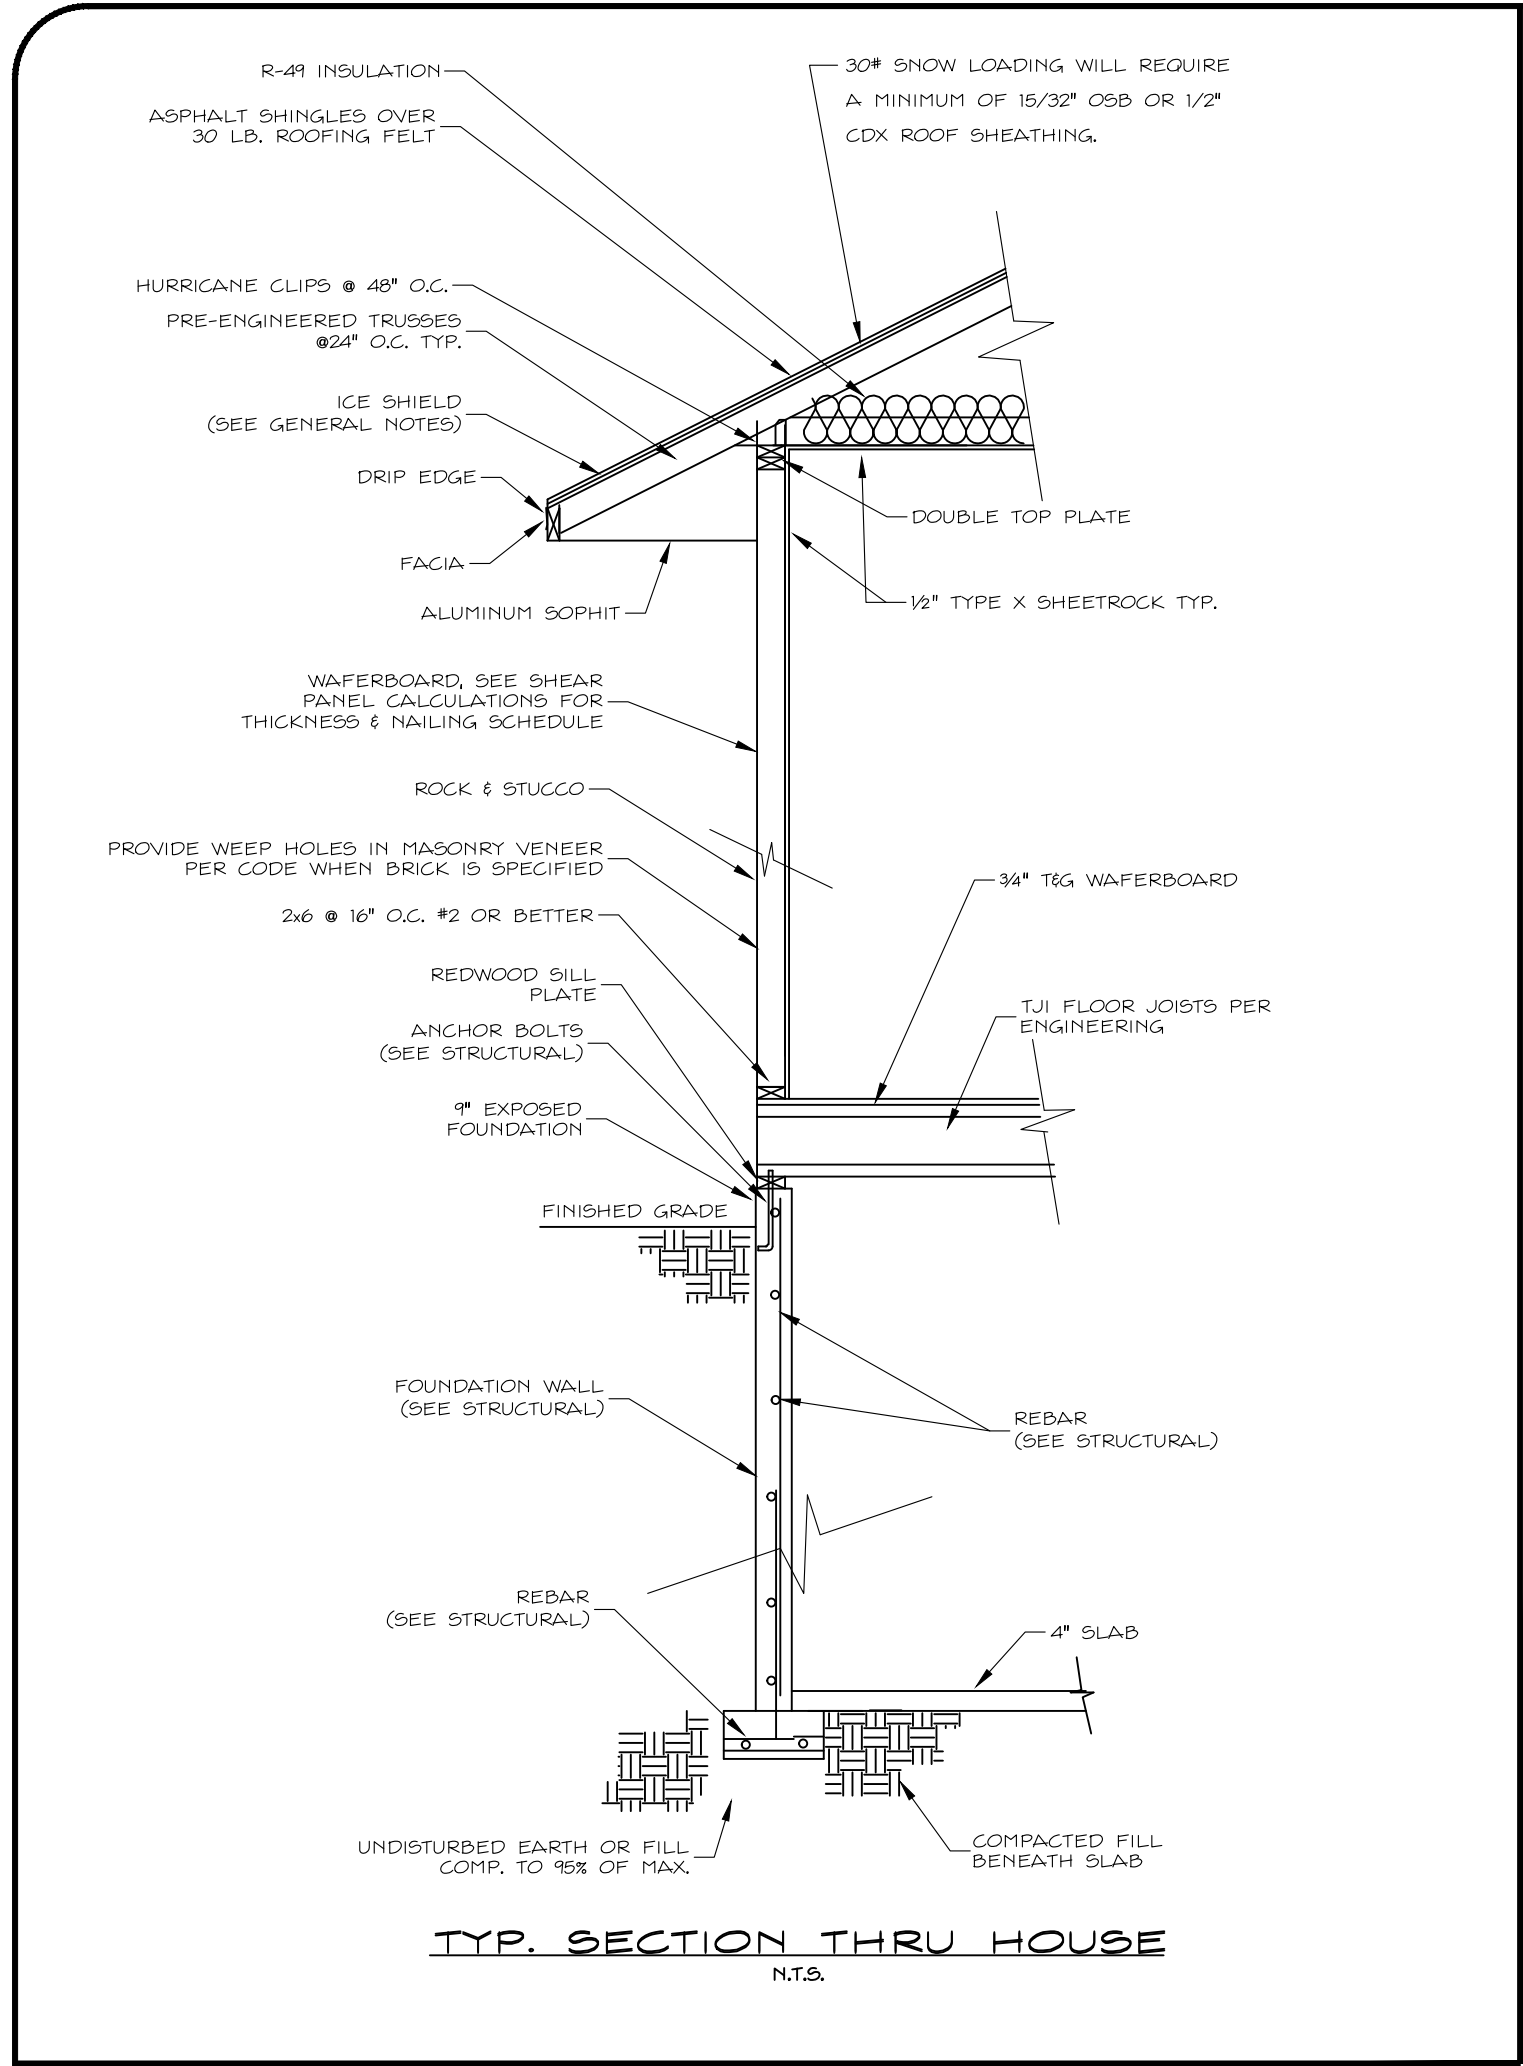

REVISIONS

PHILLIPS CONSTRUCTION

BRADY BIRD SECTION & DETAILS

PAYSON, UTAH

8385 SOUTH 3200 WEST
SPANISH FORK, UT 84660
801-794-3738
Web: www.dddesignconcepts.com

Design Concepts Inc.
D & D

DRAWN BY: JM

DATE: 08/25

SCALE: 1/4" = 1' - 0"

PROJECT # 2K2525

SHEET # 9 OF 9

WINDOW SCHEDULE		
SYMBOL	QTY.	DESCRIPTION
	2	2066 SINGLE HUNG (BOTTOM 1/3 OPERABLE)
	4	3050 SINGLE HUNG WINDOW
	1	3016 SLIDER
	2	3066 SINGLE HUNG (BOTTOM 1/3 OPERABLE) (ONE IS TEMPERED)
	2	4016 TEMPERED OBSCURED SLIDER WINDOW
	3	4066 SINGLE HUNG (BOTTOM 1/3 OPERABLE)
	1	5060 SLIDER WINDOW
	2	5066 FIXED WINDOW
	1	6016 SLIDER WINDOW
	1	6050 SLIDER WINDOW

DOOR SCHEDULE		
SYMBOL	QTY.	DESCRIPTION
	4	2480 INTERIOR DOOR
	5	2680 INTERIOR DOOR
	2	2880 INTERIOR DOOR
	1	3068 EXTERIOR DOOR
	1	3080 EXTERIOR ENTRY DOOR
	1	3080 EXTERIOR GLASS DOOR
	1	2880 EXTERIOR DOOR W/20 MIN. FIRE DELAY
	1	3680 BARN DOOR
	2	5080 INTERIOR GLASS DOUBLE DOORS
	1	18' X 8' GARAGE DOOR

